



## **Multifunctional graphene oxide/biopolymer composite aerogels for microcontaminants removal from drinking water**

Downloaded from: <https://research.chalmers.se>, 2025-12-04 09:45 UTC

Citation for the original published paper (version of record):

Kovtun, A., Campodoni, E., Favaretto, L. et al (2020). Multifunctional graphene oxide/biopolymer composite aerogels for microcontaminants removal from drinking water. *Chemosphere*, 259(November 2020).  
<http://dx.doi.org/10.1016/j.chemosphere.2020.127501>

N.B. When citing this work, cite the original published paper.

# Multifunctional graphene oxide/biopolymer composite aerogels for microcontaminants removal from drinking water

Alessandro Kovtun,<sup>a,‡</sup> Elisabetta Campodoni,<sup>b, ‡</sup> Laura Favaretto,<sup>a</sup> Massimo Zambianchi,<sup>a</sup>  
Anastasio Salatino,<sup>c</sup> Stefano Amalfitano,<sup>c</sup> Maria Luisa Navacchia,<sup>a</sup> Barbara Casentini,<sup>c</sup> Vincenzo  
Palermo,<sup>a,d,\*</sup> Monica Sandri,<sup>b</sup> Manuela Melucci<sup>a,\*</sup>

*Consiglio Nazionale delle Ricerche (CNR, Italy), a) Institute of Organic Synthesis and  
Photoreactivity (CNR-ISOF) via Piero Gobetti 101, 40129 Bologna, Italy, b) Institute of Science  
and Technology for Ceramics (CNR-ISTEC) Via Granarolo, 64 - 48018 Faenza (RA), c) Water  
Research Institute (CNR-IRSA) Via Salaria Km 29,300 C.P. 10- 00015 Monterotondo Stazione  
(RM), d) Chalmers University of Technology, Industrial and Materials Science, Hörsalsvägen 7A,  
SE-412 96 Goteborg, Sweden.*

## Abstract

Due to water depletion and increasing level of pollution from standard and emerging contaminants, the development of more efficient purification materials and technology for drinking water treatment is a crucial challenge to be addressed in the near future. Graphene oxide (GO) has been pointed as one of the most promising materials to build structure and devices for new adsorbents and filtration systems. Here, we analyzed two types of GO doped 3D chitosan-gelatin aerogels with GO sheets embedded in the bulk or deposited on the surface. Through combined structural characterization and adsorption tests on selected proxies of drinking water micropollutants, we compared both GO-embedded and GO-coated materials and established the best architecture for achieving enhanced removal efficiency toward contaminants in water. To evaluate the best configuration, we studied the adsorption capacity of both systems on two organic molecules (i.e.,

fluoroquinolonic antibiotics ofloxacin and ciprofloxacin) and a heavy metal (lead  $\text{Pb}^{2+}$ ) of great environmental relevance and with already proved high affinity for GO. The Pb monolayer maximum adsorption capacity  $q_{\text{max}}$  was 11.1 mg/g for embedded GO aerogels and 1.5 mg/g in coated GO-ones. Only minor differences were found for organic contaminants between coating and embedding approaches with an adsorption capacity of 5-8 mg/g and no adsorption was found for chitosan-gelatin control aerogels without GO. Finally, potential antimicrobial effects were found particularly for the GO-coated aerogels materials, thus corroborating the multifunctionality of the newly developed porous structures.

**Keywords.** Graphene oxide aerogels, chitosan, drinking water, lead, antibiotics, adsorption

## 1. Introduction

Drinking water contamination is a major concern to be rapidly faced with new materials and technologies. More than 30000 chemicals with a variety of chemical structures and unknown long-term toxicity and effect on the ecosystems are introduced every day into the market and directly or indirectly released into our water resources. Due to the lack of efficiency for a complete removal of emerging contaminants by wastewater treatment technologies, their occurrence in drinking water is not uncommon (Riva et al., 2018; Lapworth et al., 2012). This creates an urgent need to design versatile purification systems (i.e. adsorbent, membranes) with wider selectivity, enhanced efficiency, which can be regenerated to tackle the removal of a wide range of contaminants in a sustainable way (Joseph et al., 2017). The recently proposed recast of the European drinking water Directive 98/83/EC (Recast, (2017) 753, 2017), includes revision of the current limits for a wide list of contaminants including organic molecules, metal ions and cultivable index microbial pathogens (Annex, (2017), 753). The concentration limits for some toxic substances have been reduced (i.e., Pb and Cr), some pollutants of raising concern have been added (i.e., perfluorinated compounds,

chlorate and chlorite, endocrine disrupting compounds) and proposed microbiological assessment methods were updated.

Moreover, emerging chemical contaminants, hardly removed by conventional treatment, represent additional threats for direct human consumption of treated waters (Lapworth et al., 2012; Hartmann et al., 2018). In Europe, the Directive 2008/105/EC introduced Environmental Quality Standards for a number of emerging pollutants to protect human and environmental health. The updated Watch List includes organic contaminants, such as pesticides, pharmaceuticals, perfluorinated compounds, personal healthcare products, and heavy metals (cadmium, lead, mercury and nickel) (EU Watchlist). Along with chemicals, there are also major risks associated with the occurrence of microbial pathogens and antimicrobial resistant microorganisms even at very low concentrations, which are known to negatively influence the provision of water for drinking purposes (Nappier et al., 2018).

Water contaminants are currently removed by different technologies that often need to be combined to guarantee the required level of purity, thus urgently calling for the development of multifunctional materials possibly capable of simultaneous removal of different species of contaminants.

Due to their high specific surface area and surface reactivity as compared to conventional bulk materials, nanomaterials show high potential in controlling heavy metals, organic pollutants and microorganism removal in drinking water (Simeonidis et al., 2016; Xu et al., 2018).

In particular, graphene oxide (GO) holds great potential in this field (Ersan et al., 2017; Wang et al., 2015; Sweetman et al., 2017; Baig et al., 2019). Indeed, GO represents a scaffold with  $\pi$ - $\pi$ -interactions, hydrophobic interactions as activated carbons, but it also has polar chemical oxygen based chemical groups promoting higher hydrophilicity, electrostatic interaction, higher processability in water (Backes et al., 2020). Moreover, graphene-based nanosheets are also potentially ideal materials to intercalate/capture metal ions (Ji et al., 2019; Xu et al., 2017), hence

77 opening promising perspectives in batteries and supercapacitors applications (Mukherjeel et al.,  
78 2018).

79 Finally, graphene has been studied also for its antibacterial properties, based on the mechanical  
80 disruption and penetration of graphene platelets in the bacterial membrane (Zou et al., 2016).

81 However, despite such outstanding properties, their effect in drinking water has still to be properly  
82 evaluated (Westerhoff et al., 2018; Troester et al., 2016). Removal of GO nanosheets from treated  
83 water would not be trivial, thus their inclusion in 3D structures is required to avoid side  
84 contamination.

85 Different graphene oxide-based 3D structures have been proposed and some of them have already  
86 proved superior adsorption capability compared with Granular Activated Carbon (GAC), the  
87 industrial standard for some metal ions and organic compounds (Yousefi et al., 2019). Moreover,  
88 covalent chemical modification of the oxygen-based functionalities offers a powerful tool to tune  
89 the selectivity of GO based structures (Good et al., 2016). Defining the best approach for supporting  
90 GO on 3D structures is important to maximize the removal efficacy of the final composite.

91 Indeed, the interaction between GO and the organic molecules strongly depend on the exposure of  
92 GO sheets to the water solutions, thus the processing conditions to prepare GO composites is  
93 expected to strongly impact on the removal efficiencies and mechanism. We recently proved that  
94 PSU-GO composites adsorption of organic molecules is effective in both embedded (Zambianchi et  
95 al., 2017) or coated (Kovtun et al., 2019a; Kovtun et al., 2020) configurations with higher  
96 performance for GO coated structures in which the interlayer distance between GO sheets can play  
97 a role.

98 Along this line, we consider here gelatin-chitosan (GC) based aerogels (Barrios et al., 2019)  
99 specifically designed to host GO and compare two different fabrication approaches, based on the  
100 embedding of GO into aerogel or coating of GC. We evaluated mechanical stability, GO release and  
101 efficiency of adsorption of the targeted contaminants from water.

102 Gelatin is a hydrophilic and water-soluble protein polymer, deriving from collagen hydrolysis, then  
103 completely biocompatible. Chitosan is a natural cationic polysaccharide, deriving from the  
104 deacetylation of chitin, the main component of crustacean's exoskeletons. Both these biopolymers,  
105 selected primarily for their chemical properties and ability to form 3D structures, are waste  
106 materials of the food industry and due to their plentiful alimentary use, are highly available, low-  
107 cost and suitable to respond to the concept of circular economy. Moreover, chitosan has been  
108 widely used in water treatment by itself or as a support of more active compounds (Yang et al.,  
109 2016) and it is particularly interesting also for its natural antimicrobial activity (Hosseinnejad et al.,  
110 2016).

111 Chitosan-gelatin blends can be suitably combined and processed by freeze-drying, to achieve  
112 aerogels of customised properties in terms of porosity, density, surface area availability and  
113 structures. Cross-linking between them have been shown to create irreversible covalent bonds  
114 deriving from the reaction between pendant carboxylic and amino groups. Chitosan improves  
115 mechanical properties and prevents degradation in water observed for simple blends (Shankar et al.,  
116 2017; Campodoni et al., 2019; Krishnakumar et al., 2018). Furthermore, due to the exposed amino  
117 groups, CG aerogels can interact and react with carboxylic and epoxides groups of GO (Poletti et  
118 al., 2020) allowing to obtain stable composite devices that attract great attention in the field of  
119 biotechnology (Zhang et al., 2017).

120 To unravel the actual exposure and efficacy of GO in both composites, we perform adsorption test  
121 on two organic molecules, ofloxacin and ciprofloxacin, and Pb ions for whom GO has already  
122 proved good adsorption capacity (Peng et al., 2017; Wan et al., 2016; Zhoun et al., 2015; Wan et  
123 al., 2016; Madadrang et al., 2012). Indeed, we recently demonstrated the great affinity of GO for  
124 fluoroquinolonic antibiotics that resulted in maximum adsorption capacity ( $q_{\max}$ ) higher than 300  
125 mg/g for ofloxacin molecule for GO nanosheets (Kovtun et al., 2019a) and of about 31 mg/g for  
126 polysulfone-GO (Kovtun et al., 2019a) composites. Moreover, the removal of Pb by GO aerogel  
127 was previously tested and  $q_{\max}$  was calculated to be as high as 158 mg/g according to Langmuir

128 model (Tabrizi et al., 2016). For sake of comparison with previous published data, we used these  
129 molecules as references to check if GO was effective for adsorption in the targeted configurations  
130 more suitable for drinking water treatments.

131 It should be noted that the selected contaminants are of great environmental concern. Indeed, US-  
132 Environmental Protection Agency is keeping a watchful eye onto possible Pb contamination after  
133 water crises induced by Pb contamination into piped waters (Roy et al., 2019; Levallois et al., 2018)  
134 and in Europe 98/83/EU Directive for water intended for human consumption is currently under  
135 discussion and Pb concentration now regulated at 10 µg/L is suggested to be lowered at 5 µg/L. On  
136 the other hand, ofloxacin and ciprofloxacin are fluoroquinolonic antibiotics, with ciprofloxacin  
137 included in the EU Watch List (EU Watchlist).. Antibiotics represent one of the emerging  
138 contaminants in groundwater (Lapworth et al., 2012), since. they are frequently detected in different  
139 aquatic environments within urban water cycles (waste, surface and drinking water (Sanseverino et  
140 al., 2018; Pharmaceuticals, 2011) (Patrolecco et al., 2018).

141

## 142 **2. Materials and methods**

### 143 **2.1 Synthesis**

144 Type A pig skin gelatin (Gel, G) in powder form (mesh 4, bloom 280) was purchased from  
145 Italgelatine (Cuneo, Italy). Low molecular weight chitosan (Chit, C) was supplied by Sigma-  
146 Aldrich (MO, USA). GO was prepared by Hummer method according to previously described  
147 procedure (Melucci et al., 2012). High-purity chemical reagents were purchased from Sigma-  
148 Aldrich. Ultrapure water (Milli-Q) was used for all experiments.

#### 149 **Synthesis of Gelatin-Chitosan aerogels as control in the embedding technique (CG-E):**

150 A 2% w/w Gel solution was prepared dissolving 8 g in 400 mL of Milli-Q at 45 °C and a 2% w/w  
151 Chit solution was prepared dissolving 3.43 g in 171.42 mL of 1% acetic solution till its complete  
152 dissolution. Gel and Chit solutions were blended at room temperature for 15 min in order to obtain  
153 a Gel:Chit ratio of 70:30 and a final blend concentration of 2% w/w.

154 Blend hydrogel were freeze-dried putting into a specific home-made mould with a copper bottom  
155 and plastic wall, to perform a perfect vertical growth of ice crystal and following a specific freeze-  
156 drying cycle with a controlled freezing ramp (50 °C/h) until -40 °C and with a controlled heating  
157 ramp of 5 °C/h from 40 °C to -10 °C and to + 15 °C at 3°C/h. Dehydrothermal treatment (DHT)  
158 was carried out after freeze-drying to cross-link GC aerogels and improve their stability. Aerogels  
159 were introduced into an oven at 100 °C for 48h under vacuum (0.01 mbar).

160 **Synthesis of CGGO-E.** A 4% w/w Gel solution was prepared dissolving 8 g in 200 mL of Milli-Q  
161 at 45 °C and a 2% w/w Chit solution was prepared dissolving 3.43 g in 171.42 mL of 1% acetic  
162 solution till its complete dissolution. Gel and Chit solutions were blended at room temperature for  
163 15 min in order to obtain a Gel:Chit weight ratio of 70:30. GO suspension was prepared dispersing  
164 0.572 g in 228.5 mL of Milli-Q using a tip sonicator (Sonics, Vibra cell, VCX500, max power  
165 500W, ampl. 40 % for 10 min). GO suspension was added in GC blend for 15 min in order to obtain  
166 a final blend concentration of 2% w/w and a GO:blend weight ratio of 5:95. The composite  
167 hydrogel GCGO-E was introduced into a specific home-made mould with a copper bottom and  
168 plastic wall and, after gelation, was freeze-dried by setting a specific freeze-drying cycle: a freezing  
169 ramp of 50 °C/h, until -40 °C and a controlled heating ramp of 5 °C/h from -40 °C to -10 °C and to  
170 15°C at 3°C/h. The customised mould and process were essential to obtain a perfect vertical growth  
171 of ice crystals and thus an aligned structure in the dried composite aerogel. DHT treatment was  
172 carried out after freeze-drying to cross-link GCGO aerogels and improve their stability: the samples  
173 were introduced into an oven at 100 °C for 48h under vacuum (0.01 mbar).

174 **Synthesis of Gelatin-Chitosan aerogels as control for the coating approach (CG-C).** A 2% w/w  
175 Gel solution was prepared dissolving 8 g in 400 mL of Milli-Q at 45 °C and a 2% w/w Chit solution  
176 was prepared dissolving 3.43 g in 171.42 mL of 1% acetic solution till its complete dissolution. Gel  
177 and Chit solution were blended at room temperature for 15 min in order to obtain a Gel:Chit ratio of  
178 70:30 and a final blend concentration of 2% w/w.



179 The GC hydrogel was introduced into a specific home-made mould with a copper bottom and  
180 plastic wall and, after gelation, was freeze-dried by setting a specific freeze-drying cycle: a freezing  
181 ramp of 50 °C/h, until -40 °C and a controlled heating ramp of 5 °C/h from -40 °C to -10 °C and to  
182 15°C at 3°C/h. The customised mould and process were essential to obtain a perfect vertical growth  
183 of ice crystals and thus an aligned structure in the dried aerogel. DHT treatment was carried out  
184 after freeze-drying to cross-link GC aerogels and improve their stability. Samples were introduced  
185 into an oven at 160 °C for 48h under vacuum (0.01 mbar).

186 **Synthesis of CGGO-C.** A 2% w/w Gel solution was prepared dissolving 8 g in 400 mL of Milli-Q  
187 at 45 °C and a 2% w/w Chit solution was prepared dissolving 3.43 g in 171.42 mL of 1% acetic  
188 solution till its complete dissolution. Gel and Chit solution were blended at room temperature for 15  
189 min in order to obtain a Chit:Gel ratio of 30:70 and a final blend concentration of 2% w/w.

190 The CG hydrogel was freeze-dried was introduced into a specific home-made mould with a copper  
191 bottom and plastic wall and, after gelation, was freeze-dried by setting a specific freeze-drying  
192 cycle: a freezing ramp of 50 °C/h, until -40 °C and a controlled heating ramp of 5 °C/h from -40 °C  
193 to -10 °C and to 15°C at 3°C/h. The customised mould and process were essential to obtain a  
194 perfect vertical growth of ice crystals and thus an aligned structure in the dried aerogel. DHT  
195 treatment was carried out after freeze-drying to cross-link CG aerogels and improve their stability.  
196 Aerogels were introduced into an oven at 160 °C for 48h under vacuum (0.01 mbar).

197 GO suspension was prepared dispersing 0.572 g in 228.5 mL of Milli-Q using a tip sonicator  
198 (Sonics, Vibra cell, VCX500, max power 500W, ampl. 40 % for 10 min). The GO suspension was  
199 dropped into GC aerogels in order to obtain a final GO:blend weight ratio of 5:95 and maintained at  
200 room temperature for 15 min. Dried aerogels was obtained through another freeze-drying with the  
201 same cycle performed before (freezing ramp of 50 °C/h until -40 °C and with a controlled heating  
202 ramp of 5 °C/h from -40 °C to -10 °C and to 15°C at 3°C/h).

## 203 **2.2 SEM and porosity**

204 The scaffold morphology and the pore size were observed by environmental scanning electron  
205 microscopy (ESEM) (Quanta 600 FEG, FEI Company, Hillsbrono, OR). The specimens were  
206 mounted on aluminium stubs using carbon tape, and they were covered with a coating of Au using  
207 coating units Polaron Sputter Coater E5100 (Polaron Equipment, Watford, Hertfordshire, U.K.).  
208 The porosity was evaluated by two different methods: the density method and the water squeezing  
209 method (details in Supporting Information, Table S1). The presence of GO coating onto aerogels  
210 was observed with SEM (ZEISS LEO 1530 FEG, Germany), operated at 5 kV and secondary  
211 electrons were collected by means of an In-Lens detector.

### 212 **2.3 X-Ray Photoelectron spectroscopy (XPS)**

213 The aerogels were cut in 1 mm thin slice and fixed on conductive carbon tape for X-Ray  
214 Photoelectron analysis. The XPS spectra were recorded with a Phoibos 100 hemispherical energy  
215 analyser (Specs, Germany) using Mg K $\alpha$  radiation ( $h\nu = 1253.6$  eV; X-Ray power = 125W) in  
216 constant analyser energy (CAE) mode, with analyser pass energies of 10 eV and overall resolution  
217 of 0.9 eV on Ag 3d peak. The base pressure in the analysis chamber during analysis was  $2 \cdot 10^{-9}$   
218 mbar. All spectra were calibrated to the C 1s binding energy (285.0 eV). Spectra were fitted by  
219 using CasaXPS data analysis software ([www.casaxps.com](http://www.casaxps.com)). The atomic % were obtained from  
220 survey spectrum, while the shape of C 1s peak was acquired in order to identify the C-O and C-N  
221 present.

### 222 **2.4 Adsorption of ofloxacin and ciprofloxacin**

223 Kinetic experiments were performed in batch by dispersing the selected material (50 mg) in 10 mL  
224 of solution of ofloxacin and ciprofloxacin mixture (0.5 mg/L each) and mixing with rotator stirred  
225 speed 32 rpm in darkness and the solutions analyzed at selected intervals (1, 4 and 24 h).  
226 For isotherm experiments of ofloxacin a stock solution at 500 mg/L in tap water was prepared.  
227 Adsorption experiments were performed by dispersing 50 mg of the selected material in 10 ml of  
228 ofloxacin solution (tap water) at 0.5, 5, 25, 50, 250, 500 mg/L, prepared by dilution of the stock  
229 solution and mixed (32 rpm) for 24 h.

For isotherm experiments of ciprofloxacin, a stock solution at 250 mg/L in tap water was prepared. Adsorption experiments were performed by dispersing 50 mg of the selected material in 10 ml of ciprofloxacin solution (tap water) at 0.5, 5, 25, 50, 250 mg/L, prepared by dilution of the stock solution and mixed (32 rpm) for 24 h. Antibiotics were detected by HPLC (Dyonex Ultimate 3000) system equipped with a diode array detector. Automated injection volume was 0.2 mL. LC-MS grade acetonitrile was purchased from Sigma-Aldrich at the highest available purity and used without any further purification. Ultrapure water (18.2 MΩ/cm at 25 °C, Millipore Milli-Q system) was used. The chromatographic separation was performed on a reverse phase Zorbax C8 column 4.6 x 150 mm, 5 μm, at flow rate of 1.0 mL/min and detection performed , at maximum UV absorption of the selected analyte (details in Table S1-2 in SI). In all experiments the removal of analytes was determined by comparison with untreated solution.

## **2.5 Adsorption of lead**

Kinetic adsorption of Pb was studied in batch tests by dispersing the selected material (about 40 mg) in 40 ml of 100 μg/L Pb solution (Milli-Q water, pH 7). Solutions were mildly shaken onto orbital shaker (160 osc/min) and samples (2 ml taken by syringe without filtering) were taken at selected interval (1, 3 and 24 h).

Adsorption isotherms in batches were carried out to evaluate efficiency of different materials to remove Pb. One sample, previously equilibrated in Milli-Q, was weighed (range 40-50 mg) and added to Milli-Q solutions (40 ml in Falcon) spiked at different levels of Pb (0-20 mg/L) using Pb stock solution (1 g/L, Fluka). pH was initially adjusted to pH 6.5 ±0.5. Solutions were mildly shaken onto orbital shaker (160 osc/min) for 24 h. 2 ml of samples were taken by syringe without filtering.

All samples for adsorption studies (kinetic and isotherm) were run in duplicate, mean and standard deviation reported. Pb was measured by Atomic Absorption Spectrometer (AAS, AAnalyst800, Perkin Elmer) onto Ir-coated furnace.

After last isotherm level, a release test of adsorbed Pb was performed to evaluate if strong chemio-sorption was the mechanism involving Pb removal or it was more pore diffusion into nano-porous sponge structure. Each aerogel was put into 10 ml Milli-Q (3 times, R1, R2 and R3 namely) and shaken at 240 osc/min. Pb released was analyzed after 30 min contact time (R1 and then R2) and after 48 hours (R3). A cumulative % release value is given comparing mass release to adsorbed amount.

## 2.6 Adsorption models

Adsorption process was described by three different models Freundlich, Langmuir and BET, usually the most suitable to mimic pollutants equilibria with the adsorbent phase (Foo and Hameed, 2010; Limousin et al., 2007). Freundlich empirical model considers adsorption sites at different energies with stronger binding sites firstly occupied, while Langmuir model is based on experimental evidences and it describes solute-adsorbent equilibrium by assuming a monolayer coverage with all sites energetically equally probable. BET model is based on the assumption that exists a multilayer coverage and represents an extension of Langmuir model. A detailed model and relative parameters description are provided by Casentini et al., (2019). Briefly, we summarize hereafter used equations:

Freundlich Model 
$$q_e = K_f C_e^{1/n} \quad (1)$$

where  $q_e$  is the measured equilibrium adsorption capacity (mg/g<sub>adsorbent</sub>),  $C_e$  is the measured equilibrium solute concentration (mg/L),  $K_f$  is an indicator of the adsorption capacity (L/mg) and  $1/n$  is an indicator of adsorption intensity.

Langmuir Model 
$$q_e = \frac{q_{max} b C_e}{1 + b C_e} \quad (2)$$

280 where  $q_e$  is the measured equilibrium adsorption capacity (mg/g<sub>adsorbent</sub>),  $C_e$  the equilibrium solute  
 281 concentration (mg/L),  $q_{max}$  corresponds to the maximum adsorption capacity of a monolayer stratum  
 282 (mg<sub>Pb</sub>/g<sub>adsorbent</sub>) and  $b$  is Langmuir coefficient (L/mg).

283

284 BET model 
$$q_e = \frac{K_b C_e q_{max}}{(C_s - C_e)[1 + (K_b - 1)\frac{C_e}{C_s}]} \quad (3)$$

285 where  $q_e$  is the measured equilibrium adsorption capacity (mg/g<sub>adsorbent</sub>),  $C_e$  is the measured  
 286 equilibrium solute concentration (mg/L),  $C_s$  is solute concentration saturating first layer (mg/L),  
 287  $q_{max}$  is the maximum adsorption capacity of a monolayer stratum (mg/g<sub>adsorbent</sub>) corresponding to  
 288 Langmuir model.

289 The goodness of fit was then evaluated by calculating the coefficient of determination ( $R^2$ ) and the  
 290 Root Mean Square Error (RMSE), as described in Casentini et al. (2019).

## 291 **2.7 Flow cytometry**

292 Samples were collected in 2-mL Eppendorf safe-lock tubes and analyzed soon after sampling.  
 293 Groundwater used for the test was collected from a nearby well. The natural groundwater non-  
 294 pathogenic microbial community characterization was estimated by the Flow Cytometer A50-micro  
 295 (Apogee Flow System, Hertfordshire, England) equipped with a solid-state laser set at 20 mV and  
 296 tuned to an excitation wavelength of 488 nm.” Following previously published protocols  
 297 (Amalfitano et al., 2018), the volumetric absolute cell counting was carried out by staining with  
 298 either SYBR Green I (1:10000 final dilution; Molecular Probes, Eugene, OR, USA) or SYBR  
 299 Green I and Propidium Iodide (PI= 10 µg/mL final concentration) for 10 min in the dark at room  
 300 temperature. The light scattering signals (forward and side scatters), the green fluorescence (530/30  
 301 nm) and red fluorescence (>610 nm) were acquired for the single cell characterization.  
 302 Thresholding was carried out using the green channel. Samples were run at low flow rates to keep  
 303 the number of events below 1000 event s<sup>-1</sup>. The data were analyzed using the Apogee Histogram  
 304 Software (v89.0). The total cell counts were determined by signatures in a plot of the side scatter vs

305 the green fluorescence. Live and dead cells were differentiated in a plot of green vs red  
306 fluorescence. Viable cells showed higher green fluorescence signals than the membrane  
307 compromised dead cells selectively marked in red by PI (Amalfitano et al., 2009).

308

### 309 **3. Results and Discussion**

#### 310 **3.1 Synthesis and morphologies of CGGO aerogels**

311 Chitosan-Gelatin-GO aerogels (CGGO) and their control samples (CG) were prepared by a  
312 blending-freeze drying based approach. Moreover, to obtain stable aerogels in wet condition a  
313 physical cross-linking, dehydrothermal treatment (DHT), was carried out. Indeed, as previously  
314 demonstrated, due to the temperature and vacuum condition of DHT process, covalent amidic bonds  
315 between gelatin and chitosan are created upon DHT process, this increasing the chemical and  
316 mechanical robustness of the final aerogel (Campodoni et al., 2019).


317 For the preparation of the GO embedded aerogel, CGGO-E, GO was introduced in the polymeric  
318 hydrogel before gelation and freeze-drying. The dried composite CGGO-E, aerogel underwent DHT  
319 treatment for further stabilization at 100 °C to prevent reduction of GO (Backes et al., 2020). The  
320 control sample CG-E was prepared under the same experimental conditions.

321 On the other hand, for the preparation of GO coated aerogel CGGO-C, a GO suspension was  
322 dropped on an already DHT stabilized aerogel. For both embedded and coated aerogels the ratio  
323 GC:GO in the blend was about 2% w/w of GO. Details on the preparation conditions are reported in  
324 the experimental section and in Fig. S1.

325 The macroscopic images of the aerogels and their morphologies at different magnification are  
326 shown in Fig. 1 and Fig. S2. GO free aerogels showed a pale yellow colour while as expected, a  
327 dark colour was observed after the addition of GO in both embedded and coated samples.

328 On the other hand, large tubular pores featured by aligned channels were observed for all samples  
329 independently on the presence of GO, this being beneficial for water permeation. Density  
330 experiments (see Table S1) were also carried out to estimate the porosity. Control samples CG-E


331 and CG-C showed a porosity higher than samples with GO. Furthermore, GO coated samples  
332 revealed a porosity lower than the GO embedded ones (Fig. 1).

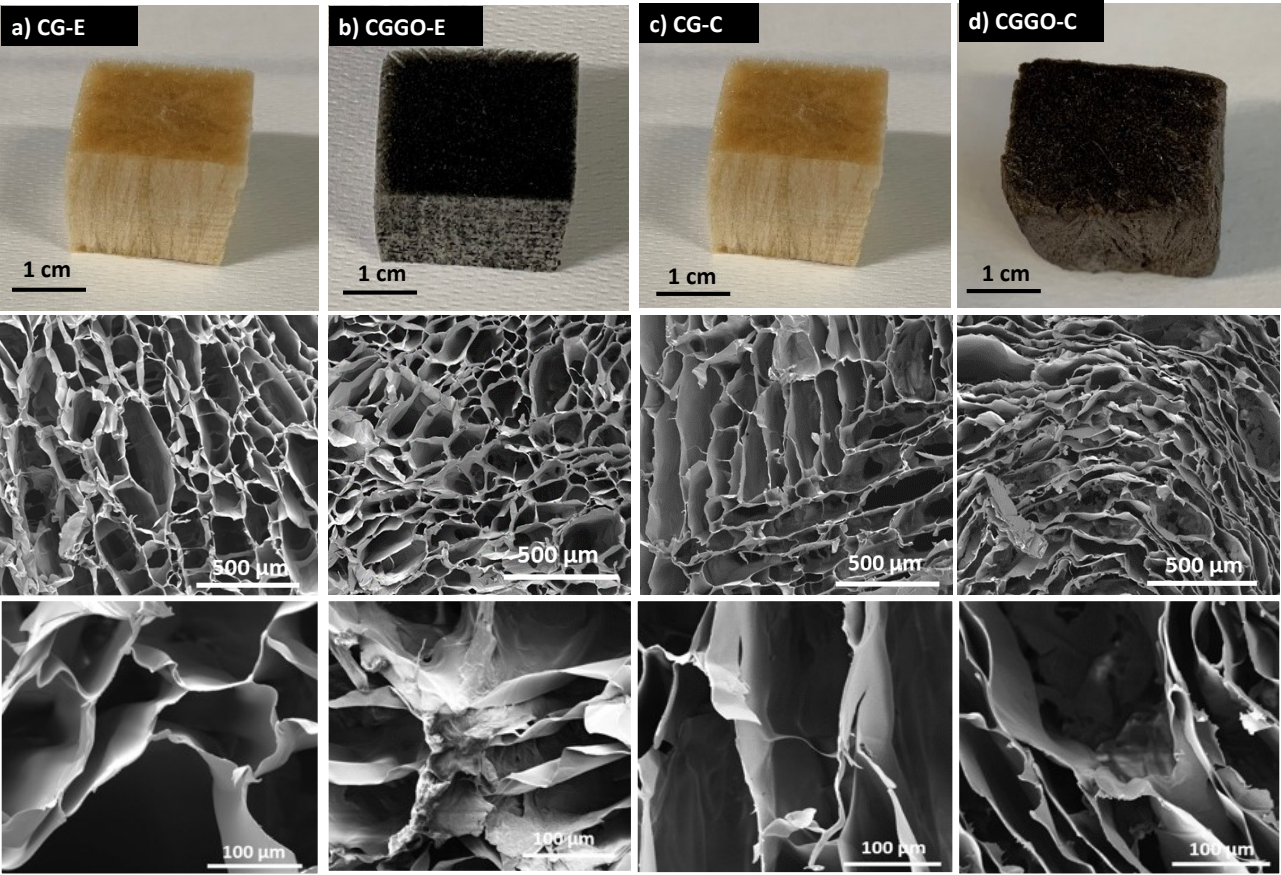

333  
334 **Fig. 1.** ESEM images of cross-sections at different magnifications of polymeric (CG-E, CG-C) and  
335 composite (CGGO-E, CGGO-C) aerogels. Aerogels up to 20 cm sized were prepared.

336  
337 A GO continuous film with thickness in the order of magnitude of tens of nm was expected in  
338 CGGO-C aerogel (Fig. 2), similar to our previous coating of polysulfone hollow fibers (Kovtun et  
339 al., 2019a). Wrinkle typically related to GO were clearly visible and not observed in CG-G control  
340 samples, which showed a smooth surface. The GO coating was even more visible at high  
341 magnification in proximity of few micrometre large crevice (Fig. 2 c,d), where the coating was  
342 partially detached from surface.

343

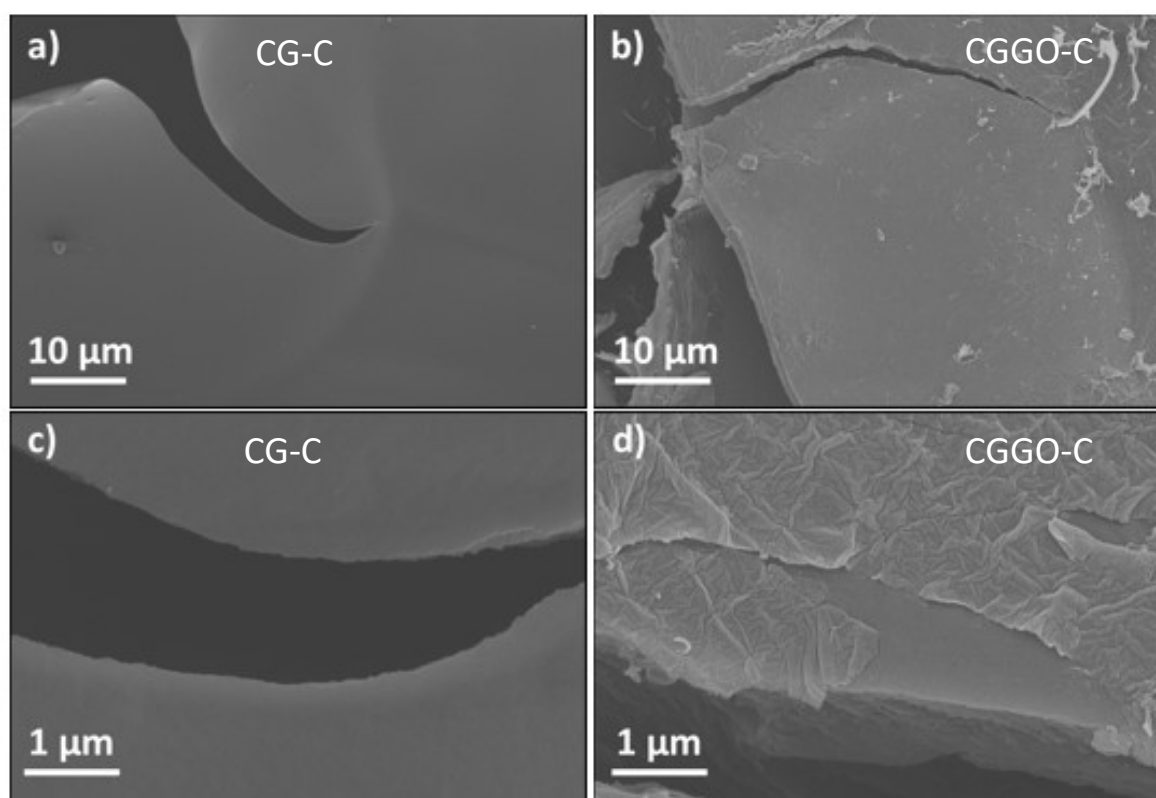

**Fig. 2.** FEG-SEM images of CG-C (a,c) and CGGO-C (b,d).

The stability of GO doped aerogels was tested by monitoring the GO release in water after 24 h of static contact. GO release was evaluated by UV-Vis spectroscopy in comparison to GO standard solutions. No evidence of GO was found in case of CGGO-E/C, hence we excluded any release at least in the detection limit range of UV-Vis spectroscopy (about 2 mg/L) (Kovtun et al., 2020; Kovtun et al., 2019a) for both embedded and coated aerogels (Fig. S3).



### 3.2 X-ray photoelectron spectroscopy (XPS)

XPS experiments were performed to check if the fabrication process induced GO changes, i.e. reduction to graphene. Survey spectra showed the signal from C 1s, N 1s and O 1s transitions (Fig. 3). The measured atomic % were close to those reported by Maachou et al. (2013) for pristine chitosan (C:O: N = 63.6: 29.2: 7.3). The binding energy (B.E.) of O 1s and N 1s peaks were in excellent agreement with literature, respectively  $532.7 \pm 0.1$  and  $399.5 \pm 0.1$  eV and the high-resolution C 1s peak confirmed the chemical structure of chitosan (Maachou et al., 2013): one C-C



group (284.8 eV), one O-C-O group (287.7 eV), while the three C-O and the C-N carbons present the same B.E. (286.2 eV). The measured C 1s signal (Fig. S4) was in good agreement with literature, C-C peak is at  $284.8 \pm 0.1$  eV, C-O/C-N at  $286.4 \pm 0.1$  eV and O-C-O at  $287.9 \pm 0.1$  eV, the relative abundances of carbon functional groups were close to pure chitosan. However, the amount of C-C carbon is slightly higher respect to the theoretical value, probably due to residual from gel and/or to the atmospheric contaminations (samples were stored in air).

The C 1s signal from CG-B, CGGO-B and CG-C featured the same shape and could be associated to the chemical structure of chitosan, while the C 1s of CGGO-C showed a completely different shape, not compatible with chitosan: the presence of aromatic and aliphatic C-C bonds at c.a. 285 eV and the peak at 286.7 eV indicated that GO was present in large amount on surface. Consequently, the C 1s peak was fitted by using the model proposed for GO (Kovtun et al., 2019b) i.e. aromatic carbon ( $C=C$   $sp^2$ , 284.4 eV), aliphatic carbon ( $C-C$   $sp^3$ , 285.0 eV), hydroxyl (C-OH, 285.7 eV), epoxy (C-O-C, 286.7 eV), carbonyl ( $C=O$ , 288.0 eV), carboxyl ( $O-C=O$ , 289.1 eV) and aromatic carbons near vacancies ( $C-C^*$   $sp^2$ , 283.5) (Larciprete et al., 2012). Moreover, the amount of N 1s was extremely low respect to the other aerogels (1.7 % compared with 10%), this confirming the high coverage of GO on CGGO-C surface.

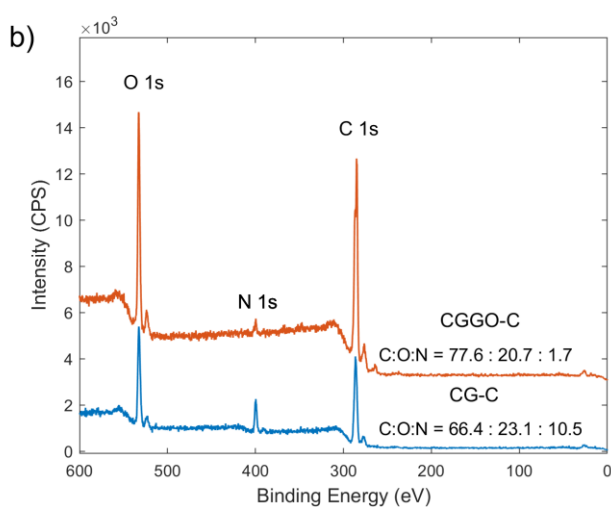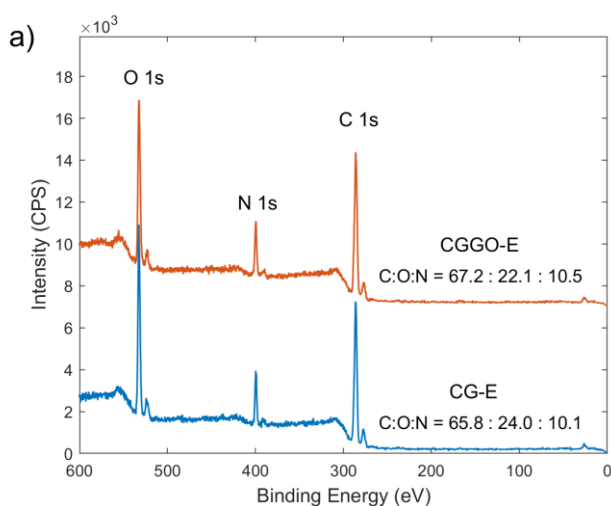


**Fig. 3.** Survey XPS spectra of a) CG-E and CGGO-E; b) CG-C and CGGO-C. The composition obtained from each spectrum are reported as atomic %.

### 3.3 Adsorption tests embedded vs coated aerogels

The adsorption kinetic of ofloxacin and ciprofloxacin (Fig. S5) of GO-doped materials and of GO-free control samples was tested over time (1-4-24 h) by dipping an aerogel sample in a solution of the two compounds at 0.5 mg/L in tap water. Negligible adsorption was found for chitosan-gelatin controls even after 24h treatment (figure 4 and fig. S5 for ciprofloxacin). On the other hand, GO embedded aerogels GCGO-E showed removals of 45% and 70% for ofloxacin and ciprofloxacin

388 respectively after 4 h (see fig. S5 for ciprofloxacin), while GO coated sponges GCGO-C showed a  
 389 removal around 70% for both compounds already after 1 h treatment.

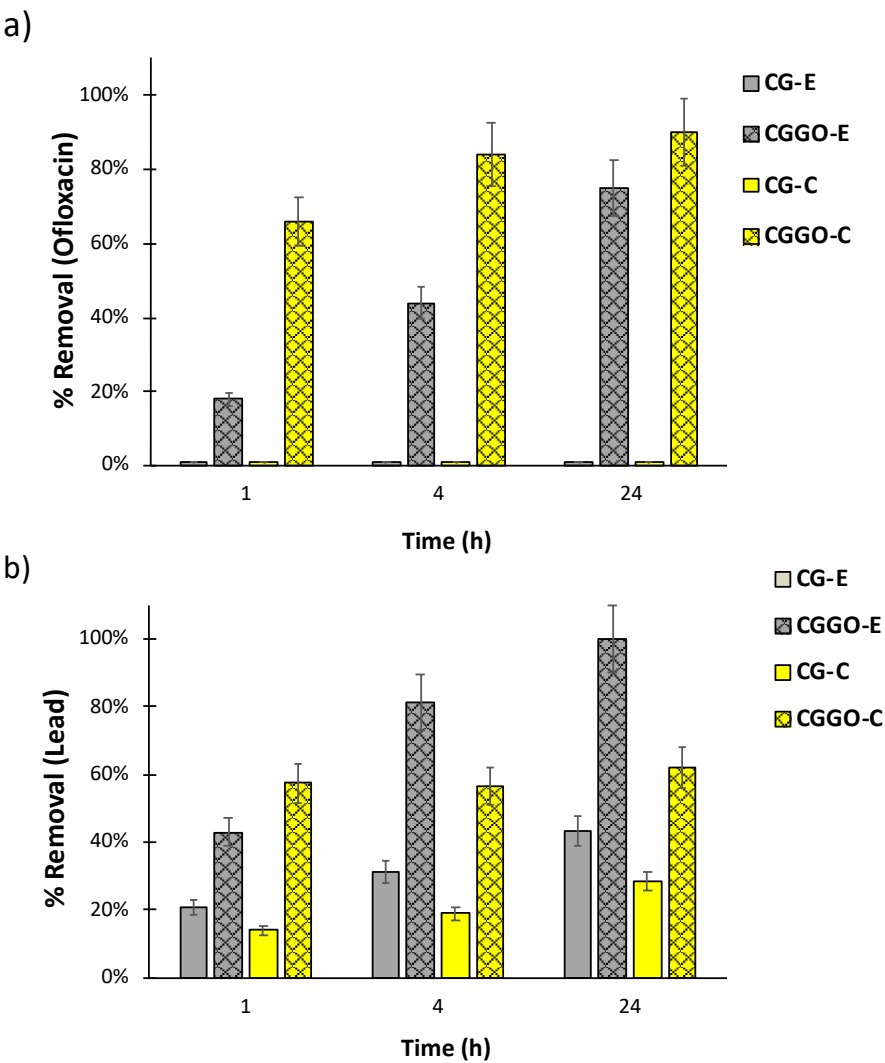

390

391

392 **Fig. 4.** Kinetics of removal of ofloxacin (a) and Pb (b) by the different samples. The initial  
 393 concentration of Pb and ofloxacin was 100  $\mu\text{g/L}$  and 500  $\mu\text{g/L}$ , respectively. Kinetic for  
 394 ciprofloxacin adsorption is shown in Fig. S5.


395

396 For both systems the removal of ofloxacin and ciprofloxacin increased with time indeed values up  
 397 to 80-90% were found after 24 h (see also Fig. S5 for ciprofloxacin), this suggesting that the  
 398 diffusion of both organic molecules into the aerogel was similar and not very fast.

399 Pb removal efficiency was about 60% and quite stable over time for CGGO-C, while it ranged from  
 400 43% (1h) to 100% (24 h) for CGGO-E.

401 We conclude that for  $\text{Pb}^{+2}$  adsorption contact time was not a limiting factor for coated material  
 402 (CGGO-C), where all adsorption sites are easy reachable on the surface while diffusion into  
 403 materials becoming very important in embedded material (CGGO-E) where increasing the contact  
 404 time adsorption increases, indicating that in this case active sites are less promptly available. In  
 405 control samples (aerogel without GO) negatively charged surface of chitosan also provide good  
 406 electrostatic attraction for positive Pb (Mishra et al., 2013; Wan et al., 2010) and the removal at an  
 407 initial concentration of 100  $\mu\text{g/L}$  was 20.8-43.1% in CG-E and 13.9-20.5% in CG-C. Wan et al.  
 408 (2010) showed that at pH above 4 metals removal by chitosan increased and reached a plateau  
 409 indicating that at circumneutral pH, as in our case (pH 7) the amino group was deprotonated. At this  
 410 condition the chelation mechanism outranked the adsorption mechanism where more metal ions  
 411 chelate with chitosan.

412 Adsorption isotherms experiments were performed to establish the maximum adsorption capacity  
 413 (see Section 2.4 and 2.5 and results in Table S2 and S3). Different isotherm models were taken into  
 414 accounts, however as shown by Fig. 5 the adsorption is well described by BET model, indicating a  
 415 multilayer adsorption, and the difference in performance between bulk (CGGO-E) ad coating  
 416 (CGGO-C) were negligible with 1<sup>st</sup> layer maximum adsorption capacity in the range between 4 and  
 417 8 mg/g in samples with GO (CGGO-E and CGGO-C). In the case of embedded material the 1<sup>st</sup>  
 418 layer maximum adsorption  $q_{\text{max}}=4.6$  mg/g (ofloxacin) is in agreement with the maximum capacity  
 419 of polysulfone-GO membranes doped with 5% w/w of GO and obtained by phase inversion  
 420 (Zambianchi et al., 2017) (i.e.  $q_{\text{max}}$  4 mg/g) and it is similar to the maximum capacity of coated  
 421 sample CGGO-C (8.3 mg/g).

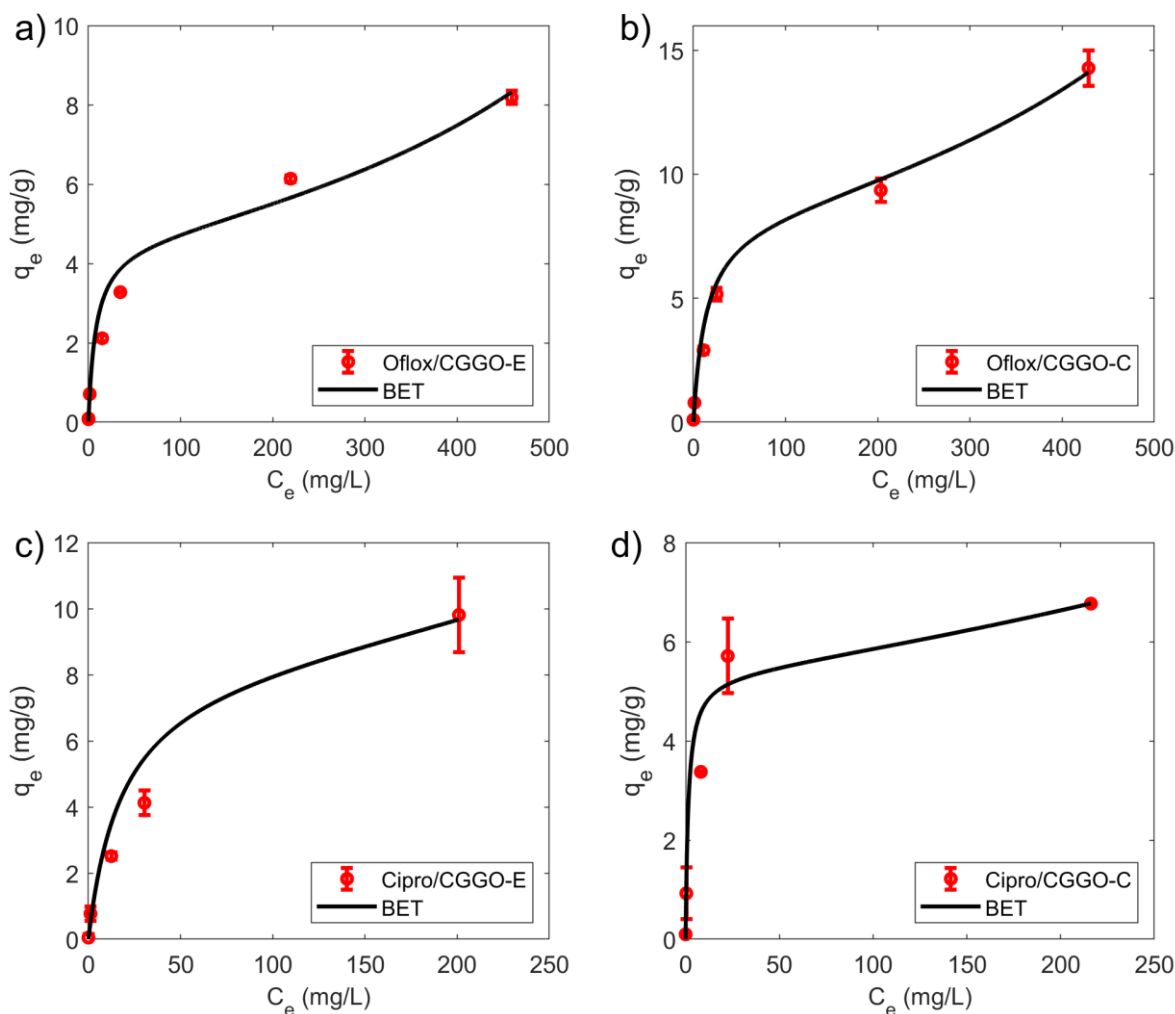


**Fig. 5.** Adsorption isotherms of Ofloxacin (a,b) and Ciprofloxacin (c,d) of CGGO-E (a,c) and CGGO-C (b,d) samples.

Similarly to organic adsorptions tests, negligible removal was found for GO free samples at these higher concentration. Nevertheless, in the case of Pb removal, higher performances were estimated for embedded sample CGGO-E respect to coated one CGGO-C.

Indeed, sample CGGO-E showed highest adsorption efficiency with a BET type behavior reaching a max adsorption monolayer capacity of 11.1 mg/g while in its control without GO  $q_{\max}$  was only 0.7 mg/g according to Langmuir best fit (Fig. 6). Also, in the sample CGGO-C higher adsorption was observed compared to its control, with monolayer max adsorption capacity 1.5 mg/g and 0.5 mg/g for CGGO-C and CG-C, respectively (see Table S2 for model parameters and selection).

435

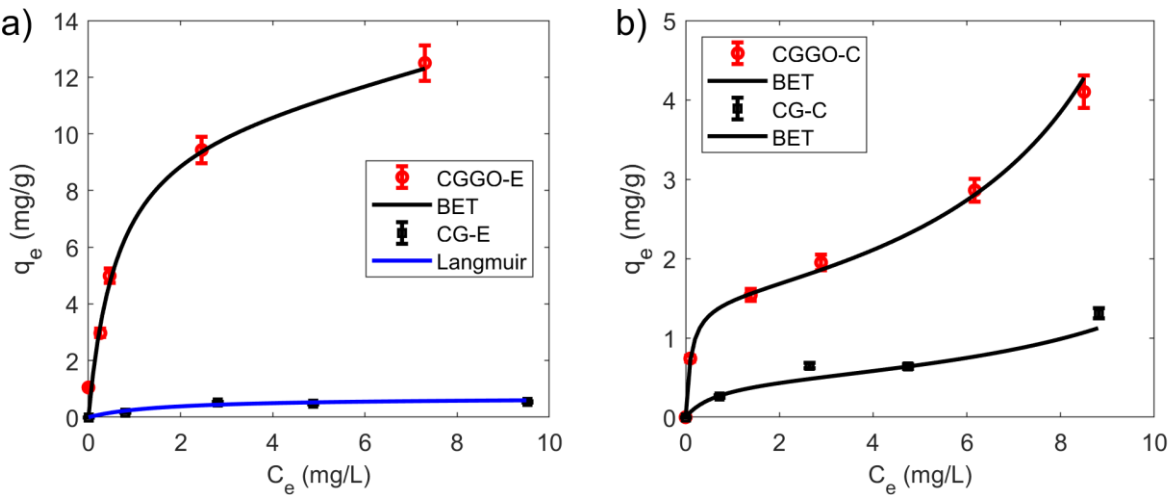

436

437 **Fig. 6.** Pb adsorption onto a) GO embedded aerogel and its control and b) GO coated aerogels and  
438 its control. Data are reported as mean values and relative standard deviation. Best fitting prediction  
439 model line are reported: BET model and Langmuir Model.

440

441 **Table 1.** Monolayer maximum adsorption capacity ( $q_{\max}$  in mg/g) of ofloxacin, ciprofloxacin and  
442 Pb on all samples. Values from BET adsorption model, except \*Langmuir adsorption.

|                      | CG-E     | CGGO-E   | CG-C    | CGGO-C  |
|----------------------|----------|----------|---------|---------|
| <b>Ciprofloxacin</b> | <0.1     | 8.4±0.8  | <0.1    | 5.3±0.5 |
| <b>Ofloxacin</b>     | <0.1     | 4.6±0.5  | <0.1    | 8.3±0.8 |
| <b>Pb</b>            | 0.7±0.1* | 11.1±0.3 | 0.5±0.1 | 1.5±0.1 |

443

444 No release of organics was found, while release of the adsorbed Pb was about 7.2 % by CGGO-E  
445 and 34.8% by CGGO-C sponge. Therefore, adsorbed Pb is not only higher in embedded aerogels  
446 but also more stable. The better performance of embedded aerogels can be likely ascribed to the  
447 instauration of stronger monolayer adsorption bonds due to major availability of graphene  
448 nanosheets at prolonged contact time while weaker multilayer adsorption at higher initial

449 concentrations (up to 20 mg/L) for coated aerogels is due to electrostatic repulsions on GO coating  
450 surface, as confirmed by BET best fit.

451 Collectively, embedded systems showed slightly better removal capacity than coated one with  
452 respect to the adsorption of both organics and Pb, but adsorption was slower for Pb. No adsorption  
453 was observed for control systems CG-E/C in the case of ofloxacin and ciprofloxacin, hence their  
454 removal can be totally ascribed to GO. On the contrary, Pb adsorption was also observed not coated  
455 aerogels due to electrostatic attraction and amino group chelation of chitosan, nevertheless GO coating  
456 raised significantly their removal efficiency.


457

### 458 **3.4 Microbial removal efficiency and viability assessment**

459 Flow cytometry was used as a rapid tool to assess the removal of the total microbial cells by  
460 filtering waters through the aerogels (i.e. inlet vs outlet waters). Moreover, the microbial viability  
461 was evaluated considering the increase of membrane-damaged cells in comparison to the control  
462 treatment. The performances of the new materials were evaluated by flow cytometry considering  
463 the changes in total cell counts (TCC) and membrane integrity (% of dead cells over the total)  
464 between the source and the filtered waters. The microbial water quality assessment of  
465 nonpathogenic microorganisms through flow cytometry can be applied to determine the  
466 effectiveness of water filtration treatments, also facilitating the optimization of reclamation  
467 procedures in experimental and pilot studies and the upscaling to full-scale plants (Safford et al.,  
468 2019; Vergine et al., 2020).

469 In this study, TCC increased only slightly over time in comparison to the control sample with no  
470 treatment, but without significant differences between treatments at 24h of incubation. The CG  
471 aerogels were likely to provide substrates suitable for microbial growth. However, potential  
472 antimicrobial effects were clearly visible already at 1h in CGGO-C, with an increase of one order of  
473 magnitude of membrane-compromised cells in comparison to the control. Interestingly at 24 h, a net  
474 increase of dead cells was observed in all treatments (Fig. 7). The major antimicrobial effect

475 observed at CGGO-C suggested that homogeneous GO coating on the sponge surface was more  
 476 effective in damaging cell membranes at the microbial community level than the GO-embedded  
 477 within the sponges. Our findings are in line with previous observations reported by testing pure  
 478 microbial cultures (Liu et al., 2018).  
 479

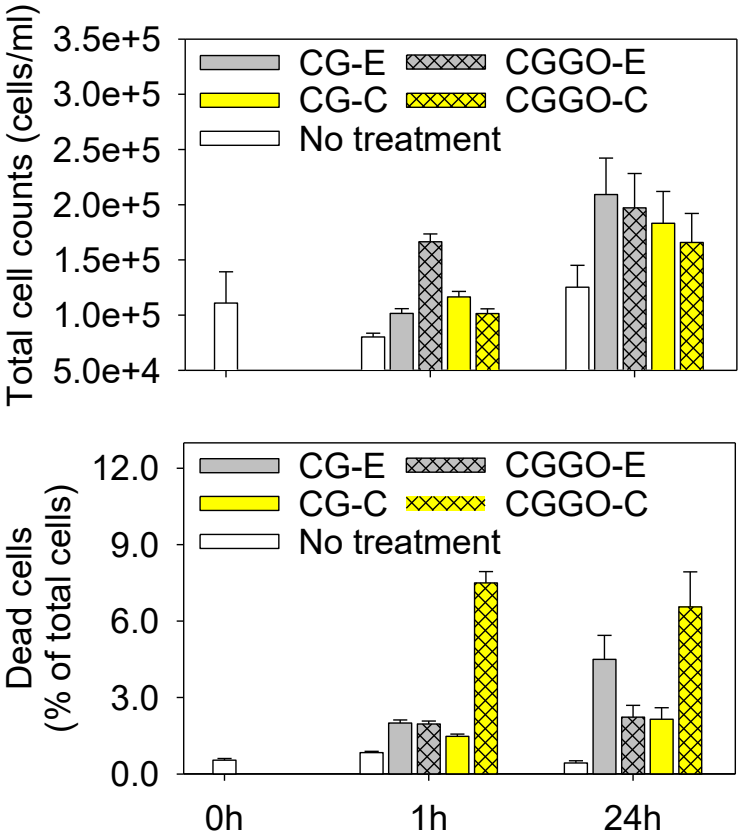

480  
 481 **Fig. 7.** Flow cytometric characterization of the water microbial community upon filtration through  
 482 CG and CGGO aerogels. The total cell counts, and the percentage of dead cells were assessed after  
 483 1h and 24h from filtration. “No treatment” refers to water sample with no sponge.  
 484  
 485

## 486 5. Conclusions

487 In summary, we reported the fabrication of novel eco-sustainable aerogels made by chitosan-  
 488 gelatin, CG, and GO and their characterization as adsorbent for water purification. We compared  
 489 two different composites polymer-GO (2% w/w) consisting of i) bulk aerogels with GO embedded



490 in the porous matrix and ii) aerogel coated with a GO layer. Adsorption tests performed on selected  
491 fluoroquinolonic antibiotics and Pb contaminants showed faster adsorption for GO coated samples,  
492 especially for Pb ions. Similar maximum adsorption capacity between GO embedded and GO  
493 coated materials was observed with respect to fluoroquinolonic antibiotics. On the contrary, in the  
494 case of Pb the adsorption efficiency was significantly higher (one order of magnitude) and stronger  
495 in embedded samples where monolayer adsorption capacity was described by Langmuir model.  
496 Collectively these results show that both GO embedding and coating are valuable strategies to  
497 exploit GO sorption capability through hydrophobic (GO-organics) or electrostatic (GO-Pb)  
498 interactions. For antibiotics removal, the amount of GO seems the key factor to maximize the  
499 removal efficacy while for Pb removal embedding approach seems to work better likely due to  
500 instauration of stronger monolayer bonds onto available sites respect to coated samples.

501 In both cases, the comparison with GO free controls demonstrate that adsorption of ofloxacin,  
502 ciprofloxacin and Pb can be totally ascribed to GO. Antimicrobial effects were visible already after  
503 1h of incubation, with an increase of one order of magnitude of membrane-compromised cells for  
504 CGGO-C in comparison to the control, this being of relevance for possible implementation in filters  
505 for drinking water.

506 In this work a limited amount of GO (2% w/w) was used for the preparation the targeted  
507 coated/embedded structures, but the fabrication procedure developed is compatible with higher GO  
508 amounts. This would enhance the removal efficiency up to the maximum capacity allowed by GO,  
509 making CGGO aerogels valuable candidates for the realization of truly multifunctional filters for  
510 drinking water. Work in this direction is currently under way.

511

## 512 **Acknowledgments**

513 The research leading to these results has received funding from the European Union's Horizon 2020

514 research and innovation programme under GrapheneCore2 785219 – Graphene Flagship, POR-  
515 FERS 2014-2020 DGR 986/2018 MEDFIL (B54I19000030005) and Italian-PRIN 2017 NANO-  
516 CARBOCAT (B54I19002770001) and FLAGERA JTC 2019 (825207)-GO-FOR-WATER.

517

## 518 **References and Notes**

519 <sup>‡</sup> These authors contributed equally to this work.

520

521 Amalfitano, S., Fazi, S., Ejarque, E., Freixa, A., Romaní, A. M., Butturini, A., 2018. Deconvolution  
522 model to resolve cytometric microbial community patterns in flowing waters. *Cytometry Part A*,  
523 93(2), 194-200.

524

525 Amalfitano, S., Fazi, S., Puddu, A. 2009. Flow cytometric analysis of benthic prokaryotes attached  
526 to sediment particles. *Journal of microbiological methods*, 79(2), 246-249.

527

528 Baig, N., Sajid, I.M., Saleh, T.A., 2019. Graphene-based adsorbents for the removal of toxic  
529 organic pollutants: A review. *J. Environ. Manage.* 244, 370-382.

530

531 Barrios, E., Fox, D., Sip, Y. Y. L., Catarata, R. Calderon, J. E., Azim, N., Afrin S., Zhang Z., Zhai,  
532 L., 2019. Nanomaterials in Advanced, High-Performance Aerogel Composites: A Review.  
533 *Polymers*, 11, 726.

534

535 Backes, C., Abdelkader, A. M. Concepcion, A. et al., 2020. Production and processing of graphene  
536 and related materials. *2D Materials*, 7, 2, Article Number: 022001.

537

538 Campodoni, E., Heggset, E. B., Rashad, A., Ramírez-Rodríguez, G. B., Mustafa, K., Syverud, K.,  
 539 Tampieri, A., Sandri, M., 2019. Polymeric 3D scaffolds for tissue regeneration: Evaluation of  
 540 biopolymer nanocomposite reinforced with cellulose nanofibrils. *Mater. Sci. Eng. C*, 94, 867–878.  
 541

542 Casentini, B., Gallo, M.; Baldi, F., 2019. Arsenate and arsenite removal from contaminated water  
 543 by iron oxides nanoparticles formed inside a bacterial exopolysaccharide. *J. Environ. Chem. Eng.* 7,  
 544 102908.  
 545

546 Ersan, G., Apul, O.G., Perreault, F., Karanfil, T., 2017. Adsorption of organic contaminants by  
 547 graphene nanosheets: a review. *Water Res.* 126, 385-398.  
 548

549 EU Watch List: [https://ec.europa.eu/jrc/en/publication/review-1st-watch-list-under-water-](https://ec.europa.eu/jrc/en/publication/review-1st-watch-list-under-water-framework-directive-and-recommendations-2nd-watch-list)  
 550 [framework-directive-and-recommendations-2nd-watch-list](https://ec.europa.eu/jrc/en/publication/review-1st-watch-list-under-water-framework-directive-and-recommendations-2nd-watch-list)  
 551

552 Foo, K.Y., Hameed, B.H., 2010. Insights into Modeling of Adsorption Isotherm Systems. *Chem.*  
 553 *Eng. J.* 2010, 156, 2–10.  
 554

555 Good, K.D., Bergman, L. E., Klara, S.S., Leitch, M. E., Van Briesen, J.M., 2016. Implications of  
 556 Engineered Nanomaterials in Drinking Water Sources *Journal of American Water Works*  
 557 *Association- AWWA* 108, 1, E1-E17.  
 558

559 Hartmann, J., Van der Aa, M., Wuijtsa, S., Roda Husmana, A.M., Van der Hoek, J.P., 2018. Risk  
 560 governance of potential emerging risks to drinking water quality: Analysing current practice.  
 561 *Environ Sci Policy.* 84, 97-104.  
 562

563 Hosseinnajad, M., Jafari, S. M., 2016. Evaluation of different factors affecting antimicrobial  
 564 properties of chitosan. *International journal of biological macromolecules*, 85, 467-475.  
 565  
 566 Ji, K., Han, A., Hirata, A., Fujita, T., Shen, Y., Ning, S., Liu, P., Kashani, H., Tian, Y., Ito, Y.,  
 567 Fujita, J.I., Oyama, Y., 2019. Lithium intercalation into bilayer graphene. *Nat. Commun.* 10, 275.  
 568  
 569 Joseph, L., Jun, B.M., Flora, J. R.V., Park, C.M., Yoon, Y., 2017. Removal of heavy metals from  
 570 water sources in the developing world using low-cost materials: A review. *Chemosphere.* 229, 142-  
 571 159.  
 572  
 573 Kovtun, A., Zambianchi, M., Bettini, C., Liscio, A., Gazzano, M., Corticelli, F., Treossi, E., M. L.  
 574 Navacchia, Palermo, V., Melucci, M., 2019a. Graphene oxide-polysulfone filters for tap water  
 575 purification, obtained by fast microwave oven Treatment. *Nanoscale*, 11, 22780-22787  
 576  
 577 Kovtun, A., Bianchi, A., Zambianchi, M., Bettini, C., Corticelli, F., Ruani, G., Bocchi, L., Stante,  
 578 F., Gazzano, M., Marforio, T. D., Calvaresi, M., Minelli, M., Navacchia, M. L., Palermo, V.  
 579 Melucci, M., 2020. Core-shell graphene oxide-polymer hollow fibers as water filters with enhanced  
 580 performance and selectivity, *Faraday Discussions*, DOI: 10.1039/C9FD00117D.  
 581  
 582 Kovtun, A., Jones, D., Dell'Elce, S., Treossi, E., Liscio, A., Palermo, V., 2019b. Accurate chemical  
 583 analysis of graphene-based materials using X-ray photoelectron spectroscopy. *Carbon* 143, 268-  
 584 275.  
 585 Larciprete, R., Locovig, P., Gardonio, S., Baraldi, A., Lizzit, S., 2012. Dual Path Mechanism in the  
 586 Thermal Reduction of Graphene Oxide. *J. Phys. Chem. C*, 116, 9900-9908.  
 587

588 Krishnakumar, G. S., Gostynska, N., Dapporto, M., Campodoni, E., Montesi, M., Panseri, S.,  
 589 Tampieri, A., Kon, E., Marcacci, M., Sprio, S., Sandri, M. 2018. Evaluation of different  
 590 crosslinking agents on hybrid biomimetic collagen-hydroxyapatite composites for regenerative  
 591 medicin. *Int. J. Biol. Macromol.* 106, 739–748.  
 592  
 593 Lapworth, D.J., Baran, N., Stuart, M.E., Warda, R.S., 2012. Emerging organic contaminants in  
 594 groundwater: A review of sources, fate and occurrence. *Environ. Pollut.* 163, 287-303.  
 595  
 596 Levallois, P., Barn, P., Valcke, M., Gauvin, D., Kosatsky, T., 2018. Public Health Consequences of  
 597 Lead in Drinking Water. *Curr. Environ. Health Rep.* 5, 255–262.  
 598  
 599 Limousin, G., J.-P. Gaudet, J.-P., Charlet, L., Szenknect, S., Barthe's, V., Krimissa, M., 2007.  
 600 Sorption isotherms: A review on physical bases, modeling and measurement. *Appl. Geochem.*  
 601 2007, 22, 249–275.  
 602  
 603 Liu, Y., Wen, J., Gao, Y., Li, T., Wang, H., Yan, H., Niu, B., Guo, R., 2018. Antibacterial graphene  
 604 oxide coatings on polymer substrate. *Applied Surface Science* 436, 624–630.  
 605  
 606 Madadrang, C. J., Kim, H. Y., Gao, G., Wang, N., Zhu, J., Feng, H., Gorrington, M., Marc L. Kasner,  
 607 M. L., Hou, S. 2012, Adsorption Behavior of EDTA-Graphene Oxide for Pb (II) Removal. *ACS*  
 608 *Appl. Mater. Interfaces*, 4, 1186-1193.  
 609  
 610 Maachou, H., Genet, M. J., Aliouche, D., Dupont-Gillain C. C., Rouxhet P. G., 2013.  
 611 XPS analysis of chitosan–hydroxyapatite biomaterials: from elements to compounds. *Surf. Interface*  
 612 *Anal.* 45, 1088–1097.  
 613

614 Melucci, M., Durso, M., Zambianchi, M., Treossi, E., Xia, Z.-Y., Manet, I., Giambastiani, G.,  
615 Ortolani, L., Morandi, V., De Angelis, F., Palermo, V., 2012. Graphene–organic hybrids as  
616 processable, tunable platforms for pH-dependent photoemission, obtained by a new modular  
617 approach. *J. Mater. Chem.*, 22, 18237-18243.

618

619 Mishra, P. C., Islam M., Patel, R. K., 2013. Removal of Lead (II) by Chitosan from Aqueous  
620 Medium. *Separation Science and Technology*, 48:8, 1234-1242.

621

622 Mukherjee<sup>1</sup>, S., Ren, Z., Singh, G., 2018. Beyond Graphene Anode Materials for Emerging Metal  
623 Ion Batteries and Supercapacitors. *Nano-Micro lett.* 10, 70.

624

625 Nappier, S. P., Soller, J. A., & Eftim, S. E., 2018. Potable water reuse: what are the microbiological  
626 risks?. *Current environmental health reports*, 5(2), 283-292.

627

628 Patrolecco, L., Rauseo, J., Ademollo, N., Grenni, P., Cardoni, M., Levantesi, C., Luprano, M. L.,  
629 Barra Caracciolo, A., 2018. Persistence of the antibiotic sulfamethoxazole in river water alone or in  
630 the co-presence of ciprofloxacin. *Sci. Total Environ.* 640–641, 1438–1446.

631

632 Peng, W., Li, H., Liu, Y., Song, S., 2017. A review on heavy metal ions adsorption from water by  
633 graphene oxide and its composites. *J. Mol. Liq.* 230, 496-504.

634

635 Pharmaceuticals in Drinking Water *WHO/HSE/WSH/11.05* [Online] **2011**.

636

637 Poletti, F., Favaretto, L., Kovtun, A., Treossi, E., Corticelli, F., Gazzano, M., Palermo, V., Zanardi,  
638 C., Melucci, M., Electrochemical sensing of glucose by chitosan modified graphene oxide, *J. Phys.:*  
639 *Mater.* 3 (2020) 014011.

640

641 Recast of the EU drinking water directive: [https://ec.europa.eu/info/law/better-regulation/have-](https://ec.europa.eu/info/law/better-regulation/have-your-say/initiatives/1563-Revision-of-the-Drinking-Water-Directive-RECAST-2017-)  
642 [your-say/initiatives/1563-Revision-of-the-Drinking-Water-Directive-RECAST-2017-](https://ec.europa.eu/info/law/better-regulation/have-your-say/initiatives/1563-Revision-of-the-Drinking-Water-Directive-RECAST-2017-)

643

644 Riva, F., Castiglioni, S., Fattore, E., Manenti, A., Davolia, E., Zuccato, E., 2018. Monitoring  
645 emerging contaminants in the drinking water of Milan and assessment of the human risk. *Int. J.*  
646 *Hyg. Environ. Health.* 221, 3, 451-457.

647

648 Roy, S., Edwards, M. A., 2019. Preventing another lead (Pb) in drinking water crisis: Lessons  
649 from the Washington D.C. and Flint MI contamination events. *Current Opinion in Environmental*  
650 *Science & Health*, 7, 34–44.

651

652 Safford, H. R., Bischel, H. N., 2019. Flow cytometry applications in water treatment, distribution,  
653 and reuse: A review. *Water Research*, 151, 110-133.

654

655 Sanseverino, I., Navarro C. A., Loos R., Marinov D., Lettieri T., 2018. State of the art on the  
656 contribution of water to antimicrobial resistance. *JRC 114775*.

657

658 Shankar, K. G., Gostynska, N., Montesi, M., Panseri, S., Sprio, S., Kon, E., Marcacci, M.,  
659 Tampieri, A., Sandri, M., 2017. Investigation of Different Cross-Linking Approaches on 3D Gelatin  
660 Scaffolds for Tissue Engineering Application: A Comparative Analysis. *Int. J. Biol. Macromol.* 95,  
661 1199–1209.

662

663 Simeonidis, K., Mourdikoudis, S., Kaprara, E., Mitrakas, M., Polavarapu, L., 2016. Inorganic  
664 engineered nanoparticles in drinking water treatment: a critical review. *Environ. Sci.: Water Res.*  
665 *Technol.* 2, 43-70.

666

667 Sweetman, M.J., May, S., Mebberson, N., Pendleton, P., Vasilev, K., Plush, S.E., Hayball, J.D.,  
668 2017. Activated carbon, carbon nanotubes and graphene: materials and composites for advanced  
669 water purification. C. 3, 18.

670

671 Tabrizi, N. S., Zamani, S., 2016. Removal of Pb(II) from aqueous solutions by graphene oxide  
672 aerogels. Water Sci Technol (1): 74, 256–265.

673

674 Troester, M., Brauch. H-J., Hofmann, T., 2016. Vulnerability of drinking water supplies to  
675 engineered nanoparticles, Water Research 96, 255-279.

676

677 Vergine, P., Amalfitano, S., Salerno, C., Berardi, G., Pollice, A., 2020. Reuse of ultrafiltered  
678 effluents for crop irrigation: On-site flow cytometry unveiled microbial removal patterns across a  
679 full-scale tertiary treatment. Science of The Total Environment, 718, 137298,

680

681 Wan, M.W., Kan, C.C., Rogel, B.D., Dalida, M.L.P., 2010. Adsorption of copper (II) and lead (II)  
682 ions from aqueous solution on chitosan-coated sand. Carbohydrate Polymers, 80, 891–899.

683

684 Wan, S., He, F., Wu, J., Wan, W., Gu, Y., Gao, B., 2016. Rapid and highly selective removal of  
685 lead from water using graphene oxide-hydrated manganese oxide nanocomposites. J. Hazard.  
686 Mater. 314, 32-40.

687

688 Wang, J., Chen, B., 2015. Adsorption and coadsorption of organic pollutants and a heavy metal by  
689 graphene oxide and reduced graphene materials. Chem. Eng. J. 281, 379-388.

690



691 Westerhoff, P., Atkinson, A., Fortner, J., Wong, M. S., Zimmerman, J., Gardea-Torresdey, Ranville  
692 J.J., Herckes, P., 2018. Low risk posed by engineered and incidental nanoparticles in drinking  
693 water. *Nature Nanotech.* 13, 661-666.

694

695 Xu, J., Dou, Y., Wei, Z., Ma, J., Deng, Y., Li, Y., Liu, H., Dou, S., 2017. Recent Progress in  
696 Graphite Intercalation Compounds for Rechargeable Metal (Li, Na, K, Al)-Ion Batteries. *Adv. Sci.*  
697 4, 1700146-1700146.

698

699 Xu, J., Cao, Z., Zhang, Y., Yuan, Z., Lou, Z., Xu, X., Wang, X., 2018. A review of functionalized  
700 carbon nanotubes and graphene for heavy metal adsorption from water: Preparation, application,  
701 and mechanism, *Chemosphere* 195, 351-364.

702

703 Yang, R., Li, H., Huang, M., Yang, H., Li, A., 2016. A review on chitosan-based flocculants and  
704 their applications in water treatment. *Water Research*, 95, 59-89.

705

706 Yousefi, N., Lu, X., Elimelech, M., Tufenkji, N., 2019. Environmental performance of graphene-  
707 based 3D macrostructures. *Nature Nanotechn.* 14, 107-119.

708

709 Zambianchi, M., Durso, M., Liscio, A., Treossi, E., Bettini, C., Capobianco, M. L., Aluigi, A.,  
710 Kovtun, A., Ruani, G., Corticelli, F., Brucale, M., Palermo, V., Navacchia, M. L., Melucci, M.,  
711 2017.

712 Graphene oxide doped polysulfone membrane adsorbers for the removal of organic contaminants  
713 from water. *Chemical Engineering Journal* 326, 130-140.

714

715 Zhang, Y. Q., Zhang, M., Jiang, H. Y., Shi, J. L., Li, F. B., Xia, Y. H., Zhang, G. Z., Li, H. J., 2017.  
716 Bio-inspired layered chitosan/graphene oxide nanocomposite hydrogels with high strength and pH-  
717 driven shape memory effect. *Carbohydr. Polym.*, 177, 116-125.  
718  
719 Zhou, G., Liu, C., Tang, Y., Luo, S., Zeng, Z., Liu, Y., Xu, R., Chu, L. 2015. Aerogel-like  
720 polysiloxane-graphene oxide gel as a highly efficient and renewable adsorbent for lead and  
721 cadmium metals removal from wastewater. *Chem. Eng. J.* 280, 275-282.  
722  
723 Zou, X., Zhang, L., Wang, Z., Luo, Y., 2016. Mechanisms of the Antimicrobial Activities of  
724 Graphene Materials. *J. Am. Chem. Soc.* 138, 7, 2064-2077.  
725