



## **Chasing the eternal sun: Does a global super grid favor the deployment of solar power?**

Downloaded from: <https://research.chalmers.se>, 2025-01-15 16:07 UTC

Citation for the original published paper (version of record):

Kan, X., Hedenus, F., Reichenberg, L. (2025). Chasing the eternal sun: Does a global super grid favor the deployment of solar power?. *Renewable and Sustainable Energy Reviews*, 211.  
<http://dx.doi.org/10.1016/j.rser.2024.115272>

N.B. When citing this work, cite the original published paper.



# Chasing the eternal sun: Does a global super grid favor the deployment of solar power?

Xiaoming Kan <sup>\*</sup>, Fredrik Hedenus, Lina Reichenberg

Department of Space, Earth and Environment, Chalmers University of Technology, 41296, Gothenburg, Sweden

## ARTICLE INFO

### Keywords:

Super grid  
Electricity trade  
Solar power  
Renewable energy  
Variation management  
Energy system modeling

## ABSTRACT

The *One Sun One World One Grid* (OSOWOG) initiative advocates the development of a *Global super grid* for sharing renewable energy, especially solar energy. This study evaluates the economic benefits of such a *Global super grid*, which connects six large regions spanning from Australia to the US, utilizing a detailed energy system optimization model and considering heterogeneous discount rates among countries. Integrating the six regions into a *Global super grid* reduces the electricity system cost by 3.8 % compared to isolating them. In contrast, grid expansion within each region reduces the electricity system cost by 13 % on average. The economic benefits of the OSOWOG initiative's *Global super grid* expansion seem to be rather limited. Moreover, the allowance for a *Global super grid* consistently results in decreased investments in solar power, indicating that it is not an effective strategy for enhancing the deployment of solar power, even when transmission grids covering 18 time zones are available.

## 1. Introduction

The past decade has witnessed substantial cost reductions and rapid deployment of variable renewable energy (VRE) technologies such as wind power and solar photovoltaic (PV) [1]. In cost-optimal scenarios for future low-carbon energy systems, wind and solar power often serve as the cornerstone of the energy supply [2–8]. Solar energy, although abundant and widely available, is limited to the daytime and subject to weather conditions [9]. However, from a global perspective, the sun never sets, as half of the earth is bathed in sunshine at any given time. The concept of continuously exploiting the ceaseless solar radiation involves the construction of an intercontinental transmission network that connects different time zones and facilitates the trading of solar energy across time zones. In line with this idea, the Prime Ministers of India and the UK jointly launched the *Green Grids - One Sun One World One Grid* (OSOWOG) initiative at the COP26 UN Climate Change Conference in Glasgow. The objective of this initiative is to facilitate the development of a *Global super grid* that would cover the entire globe, so as to promote the integration of solar energy and transmit clean energy globally at all times [10–12]. The OSOWOG initiative is planned to have three phases [11,13]. In the first phase, the Indian electricity grid will be connected to the grids in South and Southeast Asia and the Middle East. In the second phase, this grid will be connected to African regions with abundant

renewable energy resources. Finally, the third phase will complete a global, interconnected network that can be accessed by all countries. An expanded grid serves two main functions for a renewable energy system. First, it enables *resource tapping*, allowing areas with cheap and abundant solar and wind resources to export electricity to regions with high electricity demands. Second, it facilitates *variation management*, addressing the temporal variability of power production from VRE resources through spatial connections to regions with compensating generation patterns. In this study, we assess the potential benefits of constructing the *Global super grid* proposed by the OSOWOG initiative. We categorize the transmission grids within a large region (e.g., South Asia) or a continent as the *Continental grid*, and define the transmission grids connecting multiple continents as the *Global super grid*. These terms will be consistently employed throughout the remainder of this study.

Several studies [3,14–19] investigated the benefits of integrating two or more continents with transmission grids for a future renewable electricity system. These studies showed that connecting multiple continents, in contrast to isolating them, can reduce electricity system costs by up to 5 % for Eurasia [16], 1.6 % for the Americas [14], 1.3 % for Eurasia, the Middle East and North Africa [15], and 2 % for the entire world [3]. In addition, Guo et al. [18] explored the decarbonization pathway for the entire world, and suggested that introducing a *Global super grid* can reduce the electricity system cost by up to 2 %. In stark contrast, Prol et al. [17] explored the willingness to pay for electricity

\* Corresponding author.

E-mail address: [kanx@chalmers.se](mailto:kanx@chalmers.se) (X. Kan).

<https://doi.org/10.1016/j.rser.2024.115272>

Received 24 May 2024; Received in revised form 17 December 2024; Accepted 19 December 2024

Available online 4 January 2025

1364-0321/© 2025 The Authors. Published by Elsevier Ltd. This is an open access article under the CC BY license (<http://creativecommons.org/licenses/by/4.0/>).

### Abbreviations

VRE	variable renewable energy
PV	photovoltaic
OSOWOG	One Sun One World One Grid
AU	Australia
SA	South Asia
MENA	Middle East and North Africa
CSE	Central and South Europe
SAM	South America
CNA	Central and North America
CO <sub>2</sub>	carbon dioxide
O&M	operation and maintenance
OCGT	open-cycle gas turbine
CCGT	combined-cycle gas turbine
OCC	overnight capital cost
WACC	weighted average cost of capital

trade, and showed that global electricity trade, combining the complementary seasonal and diurnal cycles of solar power production, could result in a 74 % reduction in electricity system costs for most parts of the world.

In terms of variation management, it is well-established in the literature that extending transmission grids is a cost-effective strategy for managing the variability of wind power [5,6,20,21]. For solar power, some studies suggested that a *Global super grid* connecting multiple time zones could help to alleviate the intermittency of solar power by transmitting solar energy to regions that experience nighttime or winter seasons [17,22–26]. Moreover, two other studies argued that linking regions in different time zones could completely eliminate the need for dispatchable energy resources or storage in a solar power-based system [27,28].

Based on the literature, it seems that connecting several different continents for electricity trade can be beneficial or cost-effective in certain cases. Studies that conducted oversimplified analyses, such as excluding wind power and not considering transmission grid costs [17], typically found global electricity trade to be more attractive compared to more comprehensive energy system analyses [3,14–16,18]. As for the spatial smoothing effect of grid connections for solar power, previous research generally focused on assessing the physical feasibility of combining solar power generation patterns across different time zones [22–28]. However, it remains unknown as to whether such a combination is an effective strategy for deploying solar power within a comprehensive energy system. Furthermore, we observe that in previous intercontinental energy system modeling studies [3,14–18], a uniform discount rate was assumed globally, despite the substantial variations in discount rates across countries [29,30]. It is important to note that the discount rate strongly influences the cost-competitiveness of capital-intensive energy technologies [29–32].

The contributions of this study are threefold. First, we evaluate specifically the impacts of a *Global super grid*, as proposed by the OSOWOG initiative, on the cost and configuration of a future renewable electricity system. Second, in contrast to previous studies that focused solely on the *a priori* benefits of combining compensatory solar power generation patterns across different time zones [22–28], we examine whether extending transmission grids across up to 18 time zones could promote solar power deployment within a complex energy system that incorporates various energy technologies. Third, we analyze how the heterogeneity of discount rates across countries affects the expansion of a *Global super grid* and the associated benefits.

## 2. Methods

We use a techno-economic cost optimization model with hourly time resolution to model six interconnected sunny regions: Australia (AU), South Asia (SA), the Middle East and North Africa (MENA), Central and South Europe (CSE), South America (SAM), and Central and North America (CNA) (Fig. 1). The six regions include all the member countries<sup>1</sup> of the OSOWOG initiative, and each region is divided into several subregions. In total, this study covers 48 subregions spanning 18 time zones (Fig. 1). The benefits of the *Global super grid*, as proposed by the OSOWOG initiative, are assessed for a renewable electricity system<sup>2</sup> in Year 2050, considering various assumptions with respect to technology costs, heterogeneous discount rates among countries, the availability of nuclear power, hydrogen production, and uncertainty related to future electricity demands.

Our evaluation focuses on the electricity system cost and the electricity supply mix under three distinct levels of transmission connection: 1) *Isolation* – the subregions within each region are isolated from each other without transmission connections; 2) *Continental grid* – transmission expansion is permitted within each region to connect all the subregions; 3) *Global super grid* – transmission expansion is allowed to connect all six regions.

### 2.1. Energy system model

In this study, we model six interconnected regions with the open data and open source Supergrid model [33], which is a greenfield capacity expansion model with an hourly time resolution. The model optimizes investment and dispatch of the electricity sector with an overnight approach. The exception is hydropower, where existing hydropower plants are assumed to be still in operation in Year 2050, and their capacity is assumed to remain at the current level due to environmental regulations. In terms of the CO<sub>2</sub> emissions target, we assume a near-zero emissions system with a global CO<sub>2</sub> emission cap of 1 gCO<sub>2</sub> per kWh of electricity demand. The model is written in the Julia programming language using the JuMP optimization package. The cost assumptions and key parameters for technologies are summarized in Table 1. For a more detailed description of the model, see Mattsson et al. [33]. The model-specific code and input data can be found at this link: <https://github.com/xiaomingk/Supergrid>.

The main scenarios explored in this study are outlined in Table 2. The economic benefits of a *Global super grid* are examined across a broad spectrum of cost assumptions for transmission grid and nuclear power. Onshore transmission grid costs are in the range of 150–950 \$/MW/km, offshore transmission grid costs 200–1000 \$/MW/km, and nuclear power costs 2000–8000 \$/kW. For the sensitivity analysis, onshore wind power investment costs are set at 650 ('Low'), 825 ('Mid'), 1000 ('High') and 1715 ('Extremely high') \$/kW, solar PV investment costs are set at 165 ('Low'), 323 ('Mid') and 481 ('High') \$/kW, battery storage investment costs are set at 76 ('Low'), 116 ('Mid'), 156 ('High') and 385 ('Extremely high') \$/kWh, and concentrating solar power (CSP) investment costs are set at 3746 ('Default') and 6500 ('Extremely high') \$/kW. For onshore wind power, CSP and battery storage, the 'Extremely high' costs are identical to the present values.

### 2.2. Transmission assumptions

In this study, all the six regions are divided into several subregions (see Fig. 1 and Figs. S1–S6), and we assume that the subregions can be interconnected via high-voltage direct current transmission grids. The

<sup>1</sup> The member countries and the Steering Committee of the OSOWOG initiative include Australia, India, the UK, France and the US.

<sup>2</sup> This system is primarily dominated by wind and solar power, complemented mainly by hydropower, biogas power plants and battery storage.

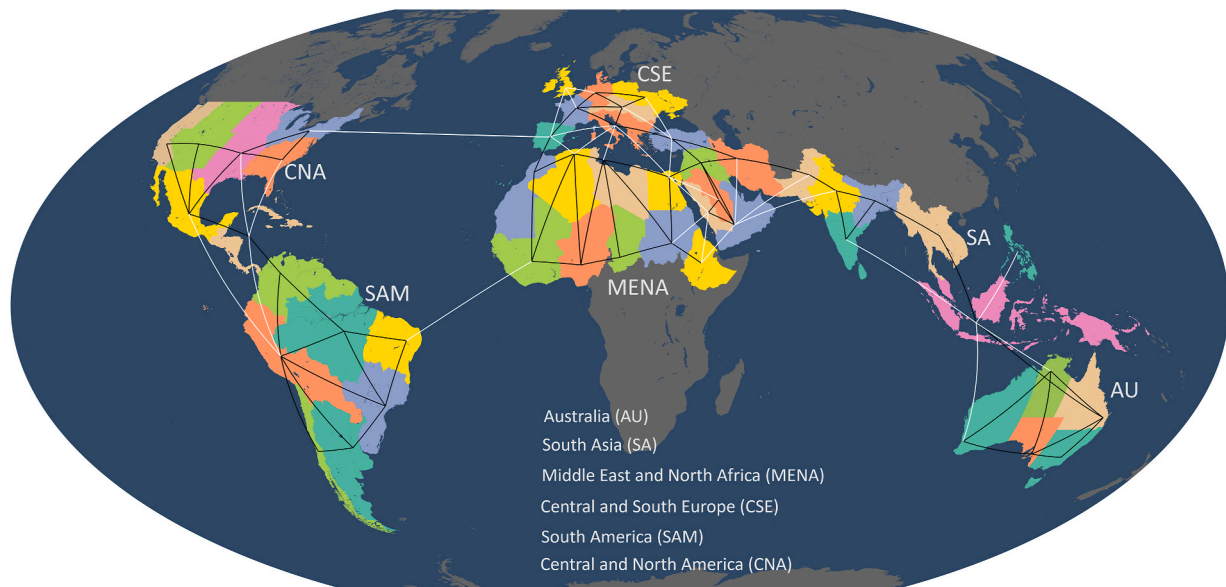


Fig. 1. The modeled interconnected regions, the subregions inside each region, and the potential transmission network topology connecting all the subregions. See Figs. S1–S6 for details of each individual region.

Table 1  
Cost data and technical parameters.

Technology	Investment cost [\$/kW]	Variable O&M costs [\$/MWh]	Fixed O&M costs [\$/kW/yr]	Fuel costs [\$/MWh fuel]	Lifetime [years]	Efficiency/Round-trip efficiency
Natural gas OCGT	500	1	10	22	30	0.35
Natural gas CCGT	800	1	16	22	30	0.6
Coal	1600	2	48	11	40	0.45
Nuclear	5000	3.5	112	2.6	40	0.33
Biogas OCGT	500	1	10	37	30	0.35
Biogas CCGT	800	1	16	37	30	0.6
Onshore wind <sup>a</sup>	825	0	33	n/a	25	n/a
Offshore wind <sup>a</sup>	1500	0	55	n/a	25	n/a
Solar PV <sup>b</sup>	323	0	8	n/a	25	n/a
Solar Rooftop <sup>b</sup>	423	0	5.8	n/a	25	n/a
CSP	3746	2.9	56	n/a	30	n/a
Electrolyzer	250	0	5	n/a	25	0.66
Hydrogen storage	11 \$/kWh	0	0	n/a	20	n/a
Fuel cell	800	0	40	n/a	10	0.5
Hydro	300 <sup>c</sup>	0	25	n/a	80	1
Onshore Transmission <sup>d</sup>	400 \$/MW/km	0	8 \$/MWkm	n/a	40	0.035 loss per 1000 km <sup>e</sup>
Offshore Transmission <sup>f</sup>	470 \$/MW/km	0	1.65 \$/MWkm	n/a	40	0.035 loss per 1000 km <sup>e</sup>
Converter <sup>d</sup>	150	0	3.6	n/a	40	0.986 <sup>g</sup>
Battery <sup>h</sup>	116 \$/kWh	0	1.5 \$/kWh	n/a	15	0.85
Demand response	0	1000	0	n/a	n/a	1

O&M, operation and maintenance; OCGT, open-cycle gas turbine; CCGT, combined-cycle gas turbine; CSP, concentrating solar power.

<sup>a</sup> IRENA [34].

<sup>b</sup> IRENA [35].

<sup>c</sup> Steffen [36], this cost refers to the expenses associated with the replacement of old mechanical and electrical machinery.

<sup>d</sup> Hagspiel et al. [37].

<sup>e</sup> Kalair et al. [38].

<sup>f</sup> Purvins et al. [39].

<sup>g</sup> Alassi et al. [40].

<sup>h</sup> Cole et al. [41], the parameters for battery are based on a 4-h lithium-ion battery system.

electricity trade is treated as a simple transport problem [21,42], and all the subregions in the model are assumed as "copper plates" without intraregional transmission constraints. Transmission costs are estimated based on whether the connection is entirely overland or partially marine, and on the length of the transmission line, which is measured as the distance between the population centers of the individual subregions [33]. Please refer to Table 3 for detailed examples of transmission connections and associated power losses.

### 2.3. Wind, solar and hydro data

An important parameter for estimating the renewable energy supply potential is how densely wind and solar power can be installed in the landscape. For this study, we first exclude areas unsuitable for large-scale wind and solar power plants. A fraction of the remaining land is then utilized as the available land for wind and solar power installations. Specifically, protected areas are excluded from the installation of wind

**Table 2**  
Scenarios of this study.

Scenario	Wind cost	Solar cost	Storage cost	CSP cost	Nuclear availability	Nuclear cost	Demand	Discount rate
Base	Mid	Mid	Mid	Default	No	–	Default	Country-specific
Uniform discount rate	Mid	Mid	Mid	Default	No	–	Default	Uniform
Plus East Asia <sup>a</sup>	Mid	Mid	Mid	Default	No	–	Default	Country-specific
Low nuclear	Mid	Mid	Mid	Default	Yes	2000 \$/kW	Default	Country-specific
Double demand	Mid	Mid	Mid	Default	No	–	Double	Country-specific
Hydrogen	Mid	Mid	Mid	Default	No	–	Plus hydrogen demand	Country-specific
Time zone smoothing	Extremely high	Low	Extremely high	Extremely high	No	–	Default	Country-specific

<sup>a</sup> In this scenario, East Asia is added as an additional region to the six regions included in the **Base** scenario.

**Table 3**  
Transmission connection examples.

Transmission connection	Distance [km]	Power loss
Australia-Asia (Indonesia)	2495	8.7 %
Asia (Saudi Arabia)-Africa (Sudan)	1314	4.6 %
Europe (Spain)-Africa (Morocco)	1042	3.6 %
Europe (Spain)-North America (The US)	5929	20.8 %
Africa-South America (Brazil)	4081	14.3 %

and solar. For the remaining areas: utility-scale solar units may be placed on all land types except forests; solar rooftop may be placed in urban areas; onshore wind power may be placed on all land types except densely populated areas (population density >500 people per km<sup>2</sup>); and offshore wind power may be placed on the seabed at a depth of up to 60 m. We assume that 5 % of the suitable area can be used for solar PV, rooftop PV and CSP, and that 10 % can be used for onshore and offshore wind power (see Table 4). For a detailed analysis of onshore wind power deployment, see Hedenus et al. [43]. The capacity factors for wind and solar are computed using the ERA5 reanalysis data (hourly wind speed, direct and diffuse solar insolation) [44] and the annual average wind speed from the Global Wind Atlas [45] for Year 2018. In the case of solar PV, we assume a fixed-latitude-tilted PV technology. The capacity factor for wind power is calculated using the power curve of a typical wind farm equipped with Vestas V112–3.075-MW wind turbines. To represent accurately the capacity factors for wind and solar power, we categorize these technologies into five classes based on resource quality [33]. Additionally, we model CSP with 10 h of thermal storage.

The existing hydropower capacity, reservoir size and monthly inflow are obtained from previous studies [46–48]. For those cases where data for certain regions are unavailable, we adopt a conservative assumption, setting the reservoir capacity as equivalent to 6 weeks of peak hydropower production. For regions where it is challenging to distinguish between reservoir and run-of-river plants due to data limitations, we assume that a minimum of 40 % of hourly water inflow must be utilized for electricity generation to constrain the flexibility offered by hydropower. Pumped hydropower is excluded from the model due to insufficient data for all the countries included in this study.

**Table 4**  
Assumptions regarding the capacity limits for wind and solar PV.

	Solar PV	Solar Rooftop	CSP	Onshore wind	Offshore wind
Density [W/m <sup>2</sup> ] <sup>a</sup>	45	45	35	5	5
Available land [%]	5 %	5 %	5 %	10 %	10 %

<sup>a</sup> The term ‘Density’ refers to the capacity assumed to be installed per unit area for a typical solar or wind farm.

## 2.4. Demand

The future electricity demand is projected with the open data, open source GlobalEnergyGIS package [33]. We first estimate the annual electricity consumption for each region in Year 2050 based on the annual demand in Year 2016 [49] and the regional demand growth between 2016 and 2050 in the Shared Socioeconomic Pathway 2 scenario [50]. We then estimate the hourly demand profile based on a machine learning approach, which adopts the historical demand profiles for 44 countries as input to a gradient boosting regression model [51]. The regression model takes into account the calendar effects (e.g., hour of day, weekday and weekend), temperature (e.g., hourly temperature in the most populated areas of each region), and economic indicators (e.g., local GDP per capita). Finally, the hourly demand series is scaled to match the annual electricity demand for each region in Year 2050. Regarding hydrogen demand, we assume that the annual demand for hydrogen is equivalent to half of the annual electricity demand. This assumption aligns with the scale of the projected hydrogen demand for Year 2050, as outlined in the European Commission’s long-term strategic vision [52]. As for demand response, we assume that a maximum of 5 % of the hourly electricity demand can be shed, at a cost of 1000 \$/MWh [53].

## 2.5. Discount rate

The fixed investment costs of renewable energy technologies are usually represented with an overnight capital cost (OCC), which is depreciated over the economic lifetime using a weighted average cost of capital (WACC) [54]. Both the OCC and WACC are project-specific and can vary by region and over time. Typically, OCC covers the costs for materials, equipment and labor [55]. WACC incorporates the financing structure of a project, which includes the costs of equity and debt, as well as government support, such as subsidies [56]. The constituent components of WACC and OCC can vary from project to project, across technologies and industries, and are heavily influenced by national and local priorities.

We recognize that it is almost impossible to estimate average values for OCC and WACC for all of the countries in the world based on a bottom-up approach that accounts for all the relevant items analyzed

above. Instead, we focus on the regional risk premium that can drive the capital investment costs of a project and the cost of servicing such investments [57]. Specifically, we assume a uniform capital cost for all projects and discount the capital cost over the lifetime with country-specific discount rates that incorporate risk premium estimates from Damodaran [57]. The country-specific discount rate is calculated by adding the risk premium to a “risk-free” baseline discount rate (5 %). The data for the risk premiums are available for most countries in the world. In cases where specific data are unavailable for certain countries, the average value derived from the neighboring countries is assigned. For each subregion covered in this study, the discount rate is determined by averaging the country-specific discount rates of the countries included in that subregion. Thereafter, the discount rate for the transmission line is decided by the node with the higher discount rate.

### 3. Results

#### 3.1. Cost savings attributed to allowing for a Global super grid

We explore the potential benefits of transmission grid expansion, as proposed by the OSOWOG initiative, by assessing the electricity system cost and the electricity supply mix under three distinct levels of transmission connection: *Isolation*, *Continental grid* and *Global super grid*. As shown in Fig. 2, allowing for transmission grid expansion inside each region consistently reduces the electricity system cost, as compared to isolating the subregions. The average electricity system cost reduction due to *Continental grid* expansion is 13 % (13 % for Australia, 7 % for South Asia, 15 % for the Middle East & North Africa, 16 % for Central & South Europe, 12 % for South America and 13 % for Central & North America). In contrast, the reduction in system costs attributed to the *Global super grid*, i.e., enabling transmission grid expansion between all six regions, is only 3.8 %. These findings indicate a significantly stronger impact on the system cost of developing *Continental grids* compared to integrating continents into a *Global super grid*. Thus, the economic benefits of a *Global super grid*, as suggested by OSOWOG, are likely to be rather limited in a renewables-based system.

We also explore the potential benefits of grid connections between India and its neighboring countries, following the plans outlined in the different phases of the OSOWOG initiative. Integrating the Indian grid with countries in Southeast Asia could result in a 7 % reduction in the overall electricity system costs (Fig. S7), while connecting India with countries in the Middle East could lead to a 13 % reduction in electricity system costs (Fig. S8). In comparison, further integrating the *Continental grid* in Asia to Africa results in only a 1 % reduction in electricity system costs (Fig. S9). It seems that linking India to its neighboring countries may offer more substantial economic benefits than extending the *Continental grid* in Asia to Africa.

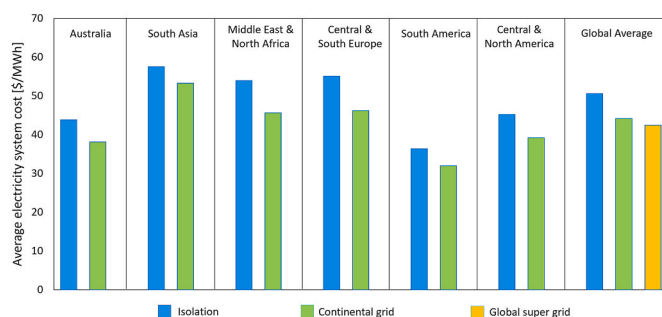


Fig. 2. Average system cost for a renewable electricity system at three different levels of transmission connection: *Isolation*, *Continental grid* and *Global super grid*.

#### 3.2. Transmission grid expansion and solar power deployment

Investment in intercontinental transmission grids occurs mainly between MENA and CSE (207 GW) and between AU and SA (107 GW)<sup>3</sup> (Fig. 3). Both CSE and SA are characterized by a high electricity demand, while MENA and AU are endowed with substantial high-quality renewable energy resources. In a renewable future, building a *Global super grid* allows these regions to reap mutual benefits, where electricity is traded from regions with high-quality renewable resources to regions with a high demand for electricity. The creation of producer/consumer regions that arise from the availability of intercontinental transmission grids is depicted in Fig. 3. The figure shows an evident increase in electricity production in MENA and AU when the six regions are integrated, whereas there is a marked decline in electricity generation in CSE and SA. Note that even with the option to invest in a transmission grid between CSE and CNA, the installed capacity remains minimal (less than 1 kW).

The OSOWOG initiative suggests developing a *Global super grid* to advance the deployment of solar PV. Our results show the opposite effect: the consequence of introducing a *Global super grid* (connecting 18 time zones) is that there is less solar PV in the electricity supply mix compared to *Continental grid* expansion (Fig. 4). In other words, solar PV is less cost-effective in the world envisioned by the OSOWOG initiative. This phenomenon is evident not only in the overall electricity supply mix for all regions, but also in the electricity supply mix for MENA (see Fig. 3). MENA has abundant high-quality solar resources, yet building a *Global super grid* to encompass this region does not enhance the integration of solar PV. To reveal more clearly the potential benefits of a *Global super grid* for solar power development, we investigate one extreme scenario (**Time zone smoothing** scenario) with a low cost for solar power, and extremely high costs (same as the present costs) for wind power, CSP and battery storage. A high cost for wind power means that solar power is more competitive. High costs for CSP and battery storage entails that domestic variation management is expensive for solar power, which potentially favors spatial smoothing of solar power's diurnal variation across a broad range of time zones. However, even with such a favorable cost configuration, no expansion of solar PV is observed in the optimal electricity supply mix when the *Global super grid* option is enabled (see Fig. 4). This result confirms that transmission grid and trade do not represent an effective tool for deploying solar power, even in the presence of transmission grids covering 18 time zones.

In comparison, connecting the six regions consistently increases the share of wind power in the optimal electricity supply mix. The increased deployment of wind power due to grid integration is consistent with the findings of national and continent-wide energy system studies [5,6,20,21]. Notably, the investment in battery storage decreases with the extension of transmission grids (**Base** scenario, Fig. 4), and so does electricity curtailment (Fig. S10). The limited presence of demand response in the electricity supply mix is primarily due to its relatively high cost compared to other electricity supply options.

#### 3.3. Impacts of country-specific discount rates

Our main results are based on country-specific discount rates, reflecting a future in which the discount rate for each country remains the same as today. However, in an optimistic future characterized by sustained political stability and consistent economic growth, the diverse discount rates across countries may gradually converge toward a common, low-risk mean value. In such a future (**Uniform discount rate** scenario), the economic benefit of a *Global super grid* increases to 5.9 %, as compared to the **Base** scenario with a system cost reduction of 3.8 %.

<sup>3</sup> The transmission capacity connecting MENA and CSE amounts to 29 % of the peak demand in CSE, while the transmission capacity linking AU and SA equals 13 % of the peak demand in SA.

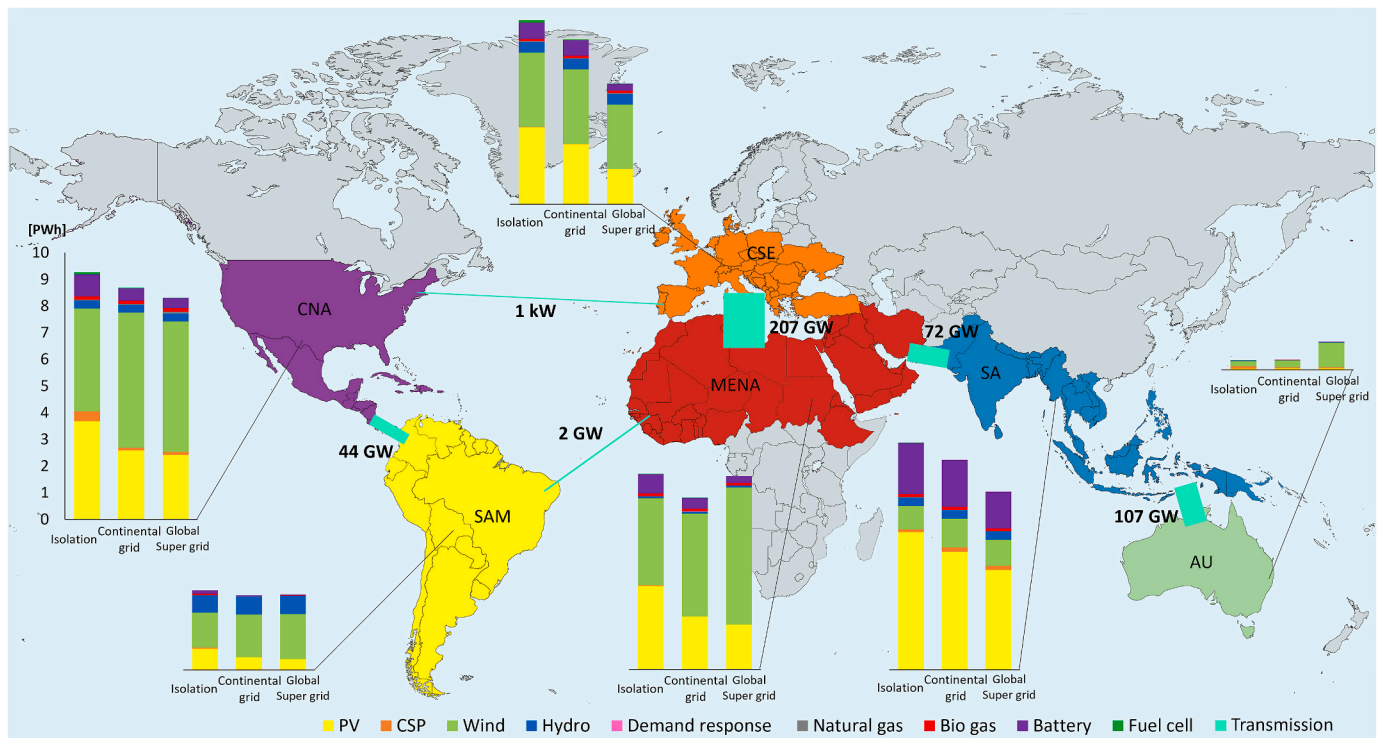


Fig. 3. Optimal transmission capacities between regions when the six regions are integrated, and the electricity supply mix for each region at three different levels of transmission connection: *Isolation*, *Continental grid* and *Global super grid*.

The lower level of benefit observed when applying country-specific discount rates is primarily attributed to the shift in investments in renewable energy towards low-risk regions (e.g., Europe) that have renewable resources of lower quality (Figs. S11 and S12). This shift weakens the resource-tapping function of a *Global super grid*. A typical example relates to MENA and Europe. With a uniform discount rate, Europe is heavily dependent on importing renewable energy from MENA (see Fig. S12a). Notably, African countries exhibit surplus electricity generation due to competitive renewable resources. In contrast, when country-specific discount rates are applied, the trade in electricity from MENA to Europe experiences a significant reduction (see Fig. S12b). As for intercontinental transmission connections, the transmission capacity between MENA and Europe decreases from 355 GW to 207 GW when accounting for the heterogeneity of discount rates. Given these outcomes, using Africa to tap the abundant renewable energy resources for Europe would require favorable socio-political developments in Africa.

### 3.4. Cost savings and solar power deployment in a wide range of scenarios

To assess whether an even larger geographic scope could enhance the benefits of a *Global super grid*, we include East Asia in our analysis (**Plus East Asia** scenario). Extending the *Global super grid* to the substantial electricity demand center in East Asia does not amplify its benefits; the overall benefit of the *Global super grid* is 3.3 %, closely aligning with the benefit (3.8 %) of connecting the original six regions (Fig. 5).


If there are alternative ways to generate low-carbon electricity, such as nuclear power, these may diminish the advantages of a *Global super grid* by weakening the dependence on renewable resource sharing and reducing the demand for variation management. We simulate this by including nuclear power in the analysis. The economic gain associated with allowing for a *Global super grid* is less than 1.2 % when nuclear power is cheap (**Low nuclear** scenario) (Fig. 5, Fig. S13). It is important to note that nuclear power is selected solely as an example of a dispatchable low-carbon generation technology. This choice does not imply

any stance on the feasibility of nuclear power for specific countries.


To examine the impacts of extensive electrification and electricity-derived fuel production on the benefit of a *Global super grid*, we consider scenarios that involve doubling the electricity demand (**Double demand** scenario) and integrating hydrogen production (**Hydrogen** scenario). The economic benefit of the *Global super grid* increases from 3.8 % to 4.9 % with a doubling of the electricity demand (Fig. 5). In a renewable future, countries that lack abundant high-quality renewable resources may need to import electricity, particularly with increasing demand for electricity. Large-scale hydrogen production significantly reduces the benefit of a *Global super grid* to only 1.4 % (Fig. 5). The flexibility provided by hydrogen production serves as an alternative variation management strategy, which weakens the impact of transmission grid expansion.

The transmission cost is a crucial factor for the development of a *Global super grid*. Therefore, we evaluate the benefits of a *Global super grid* under different transmission cost assumptions. The reduction in electricity system cost is greater than 4.3 % if either onshore or offshore transmission grid is exceptionally cheap, with the most substantial cost reduction being 6.5 % (Fig. 6). In general, a high cost for transmission grid diminishes the benefit of a *Global super grid* to less than 1.6 %. To further understand the broader conditions that may affect the cost-effectiveness of a *Global super grid*, we evaluate its benefits under various cost assumptions for wind and solar power, as well as battery storage. Across the broad range of cost assumptions, the economic benefit of connecting the six regions via a *Global super grid* is less than 5.4 % (Fig. S14). The largest cost reduction is achieved when solar PV and battery storage costs are high, and the cost of wind power is low. Such a cost combination favors investments in wind power, and a *Global super grid* allows for resource tapping and variation management for the more competitive wind power over a larger geographic area.

For all the scenarios investigated above, integrating the six regions into a *Global super grid* does not increase the deployment of solar power (Figs. S15–S19). These outcomes seem to contradict the findings of previous studies that explored the physical feasibility of harmonizing

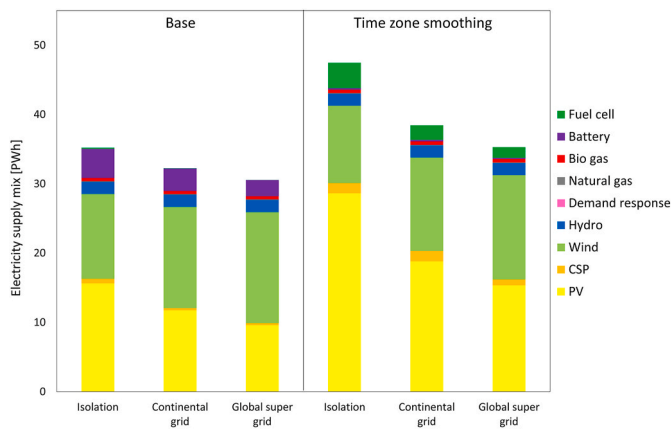


**Fig. 4.** Electricity supply mixes for the **Base** scenario and the **Time zone smoothing** scenario in which the cost assumptions for wind power, CSP and battery storage are kept at the current values. For a description of all the scenarios included in this study, see [Table 2](#) in the *Methods* section.

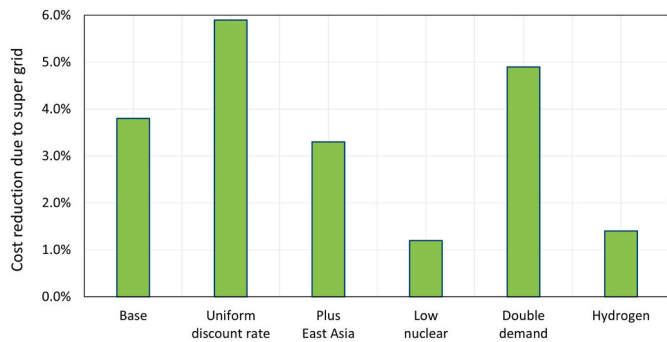

**Fig. 5.** Electricity system cost reductions linked to allowing for a *Global super grid* across various scenarios.

solar power generation patterns across diverse time zones to manage variations in solar power production [22–28]. To delve deeper into this disparity, we conduct additional experiments to pinpoint the circumstances under which a *Global super grid* could indeed bolster solar power deployment. Our findings indicate that an evident uptick in solar power

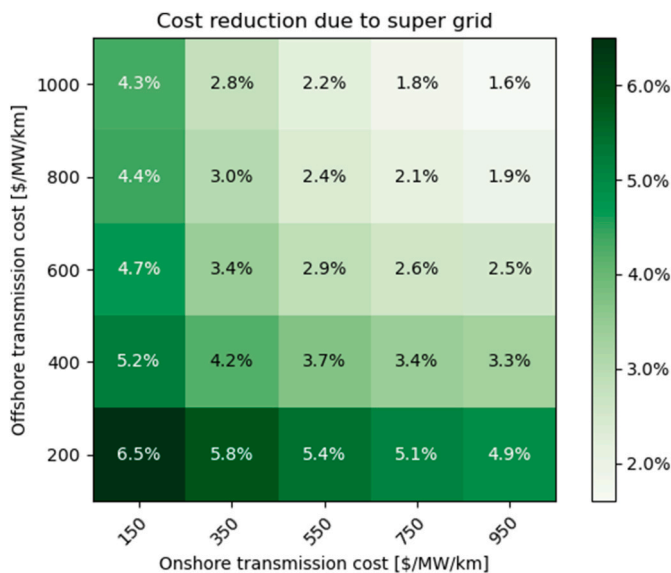

**Fig. 6.** Electricity system cost reductions linked to allowing for a *Global super grid* under different cost assumptions for the transmission grid.

deployment occurs only when the transmission cost falls below 50 \$/MW/km (Fig. 7). However, this cost is deemed unrealistically low. To provide context, this cost represents less than half of the estimated future transmission grid cost in China [58], a country that is renowned for its capability to construct extensive transmission networks at low cost. From the physical standpoint, the notion of transmitting solar energy from regions with peak solar power production, such as Morocco, to areas that are experiencing evening peak demand, such as India, presents an appealing solution for managing the diurnal variation in solar power production.<sup>4</sup> However, facilitating such an energy transfer necessitates substantial expansion of extremely long-distance transmission grids connecting India and Morocco. While this approach may *a priori* seem to be an effective way to manage the intermittency of solar power production, these advantages are ultimately offset by the substantial costs of the transmission grids. This explains why the increased share of solar energy facilitated by a *Global super grid* only appears when transmission grid costs are unrealistically low.

#### 4. Discussion

The introduction of a *Global super grid* yields a 1.2%–6.5% reduction in electricity system costs. The greater economic benefits are associated with cheap transmission grids, high costs for solar PV and storage, high energy demand and a uniform discount rate across the world. Conversely, the lower end of the benefit spectrum applies to scenarios characterized by high transmission costs or high levels of flexibility, provided by cheap nuclear power or large-scale hydrogen production. In the **Base** scenario, the reduction in electricity system costs that results from the implementation of a *Global super grid* is 3.8%. In contrast, the average economic benefit achieved through *Continental grid* expansion is approximately three times higher, reaching 13%. Significant electricity system cost reductions are also observed when connecting India to countries in Southeast Asia (7%) and the Middle East (13%), reflecting the long-term benefits of grid expansion if these countries undergo a transition towards renewable electricity systems. Our findings also highlight that if dispatchable power generation is available and cheap to invest in (**Low nuclear** scenario), the advantages of grid expansion are constrained. This reflects the current situation in India and its neighboring nations, where immediate grid connections might yield limited benefits. However, it is essential to acknowledge the time-demanding nature of grid expansion. Establishing connections between India and countries in Southeast Asia and the Middle East, in alignment with the first phase of the OSOWOG initiative in the coming decades, has the potential to yield substantial benefits for the future renewable electricity system in Asia. In summary, the benefits of the OSOWOG initiative’s *Global super grid* expansion seem limited in comparison to *Continental grid* expansion. These findings suggest that the advantages of grid expansion for resource tapping and variation management are predominantly realized within each continent. The marginal benefit of further integrating the continents appears to decrease significantly.

Our finding regarding the benefit of the *Global super grid*, as proposed by the OSOWOG initiative, is consistent with the results of most other studies [3,14–16,18], where the reduction in system cost linked to allowing for a *Global super grid* falls in the range of 0%–5%. In the present study, connecting the 48 subregions results in an overall system cost reduction of 16% compared to isolating the subregions (*Global super grid* vs. *Isolation*). In comparison, Prol et al. [17] reported a significantly greater reduction in electricity system cost (74%) from global electricity trade. The key difference between our study and that of Prol et al. [17] is that they employed a simplified, stylized model, using only solar PV and a generic dispatchable power generation technology, while focusing on the willingness to pay for electricity trade. This

<sup>4</sup> The transmission connection between Morocco and India is used solely as an example for illustrating spatial smoothing of solar PV variability.



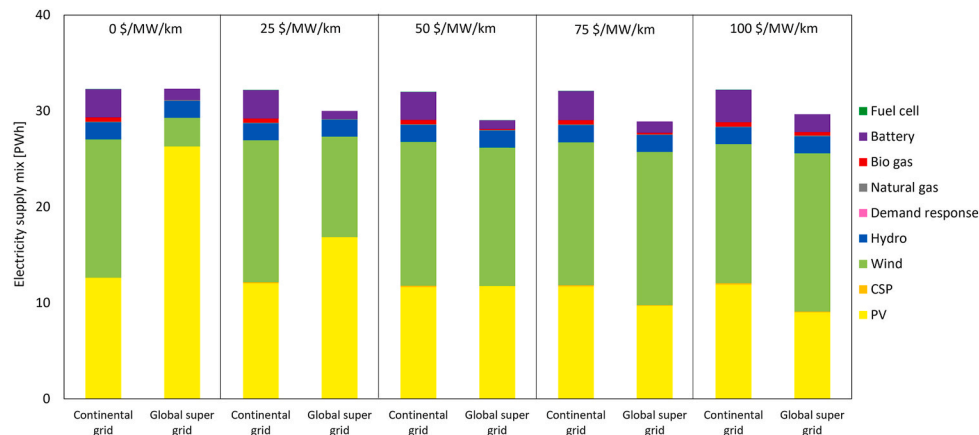


Fig. 7. Electricity supply mix for additional experiments with transmission grid costs ranging from 0 to 100 \$/MW/km.

approach did not account for transmission grid costs. To assess the impact of their methodology, we modeled a scenario with no wind power, high storage costs, and zero transmission grid costs. In this scenario, connecting the world with a *Global super grid* results in a 78 % reduction in electricity system costs, closely aligning with the 74 % reduction shown by Prol et al. [17]. Thus, it is clear that the primary factor contributing to the significant difference in results is the choice of methodology.

We also evaluate the motivation behind the *Global super grid* expansion, which relates to variation management for solar power via electricity trading. Our results show that integrating the six regions (18 time zones) always decreases investments in solar PV. Even under extreme conditions where the costs for wind, CSP, and battery storage remain at the present levels, which favors the use of electricity trading to address the variable power production of the relatively cheap solar PV, we fail to observe any increased deployment of solar energy (Fig. 4). This seems to contrast with previous studies advocating for mitigating diurnal and seasonal variations in solar power through global electricity trading [22–28]. Those studies focused on the feasibility of combining diverse solar power generation patterns. However, facilitating such energy transfers requires substantial expansion of long-distance transmission grids, the high costs of which outweigh the benefits of integrating compensatory solar power generation patterns. Therefore, from a techno-economic perspective, allowing for a *Global super grid* may not stimulate the deployment of solar power.

In this study, we apply country-specific discount rates to account for the heterogeneity of investment risks, which partly reflect how domestic socio-political factors might influence the development of a *Global super grid*. It is important to note that there are possibly other social and political barriers that could affect the development of a *Global super grid* [59]. One significant barrier involves the risk of dependency on other countries for energy supply. Recent events, such as the European energy crisis following Russia's invasion of Ukraine, have underscored the vulnerabilities associated with cross-border energy dependencies. Political tensions and concerns about energy security may reduce the appeal of relying on distant or geopolitically unstable regions for critical energy imports, a factor that may outweigh the potential economic benefits of a *Global super grid*.

Further challenges include regulatory discrepancies, grid harmonization issues, and resistance from local stakeholders who may oppose large-scale transmission infrastructure due to environmental and land-use concerns. These factors could extend implementation timelines and increase project costs, introducing uncertainty into any anticipated economic benefits of a *Global super grid*. Given the broad range of uncertainties and risks, the 3.8 % reduction in system costs calculated in our study may have limited impact when weighed against the potential for cost overruns, project delays, or disruptions. Together, these social

and political constraints, along with weak economic incentives, are likely to hinder the development of a *Global super grid*. Yet, we also recognize potential drivers, such as geopolitical alliances and favorable political decisions, which could propel the development of a *Global super grid*. Thus, political decisions might be made to develop a *Global super grid* regardless of the economic gains.

In the present study, we choose to concentrate on a pure techno-economic analysis. Our aim is to illustrate the economic baseline (system cost reduction linked to allowing for a *Global super grid*) upon which any distortions would necessarily be layered. Therefore, this paper serves a useful policy purpose by characterizing the magnitude of policy intervention needed to counteract the baseline economic benefit of a *Global super grid*.

Notably, this study investigates whether allowing for a *Global super grid* could stimulate the deployment of solar PV. Our findings do not imply a specific stance on future solar PV installations, which may be driven by various factors such as national climate policies, government incentives, and energy security goals. Consequently, substantial growth in solar PV installations may occur regardless of the availability of a *Global super grid*. Additionally, our results show that battery storage is a more effective strategy for managing solar PV variability than a *Global super grid*, indicating significant future demand for battery resources. A related challenge is the availability of critical minerals, raising the question of whether they should be prioritized for electric vehicle batteries rather than stationary storage for solar PV. While this lies beyond our study's scope, we encourage future research to explore it.

In our study, we exclude pumped hydropower due to insufficient data across the countries analyzed. Although incorporating pumped hydropower could potentially provide an additional domestic strategy for managing solar PV variability and enhancing solar integration, it is unlikely to alter our overall conclusion regarding the relationship between global transmission expansion and solar PV deployment.

## 5. Conclusion

In this study, we assess the benefits of a *Global super grid* as proposed by the OSOWOG initiative. Our analysis involves modeling a renewable electricity system across six large regions, spanning from Australia to the US, using a capacity expansion model. We consider various assumptions regarding technology costs, heterogeneous discount rates among countries, the availability of nuclear power, hydrogen production, and uncertainties about future electricity demands.

We find that allowing for a *Global super grid* leads to a 1.2 %–6.5 % reduction in electricity system costs. The significant impact on system costs for a renewable electricity system is contingent upon several factors, including extremely low cost for transmission grids, high costs for solar PV and storage, high energy demand, and a uniform discount rate

worldwide. Overall, the benefits of a *Global super grid* are rather limited compared to *Continental grid* expansion (3.8 % vs. 13 % in the **Base** scenario). Notably, we do not account for additional social and political barriers linked to large-scale long-distance transmission grid expansion. Considering these barriers may render a *Global super grid* even less attractive.

Furthermore, we evaluate the impact of a *Global super grid* on solar power deployment. Across a wide range of cost assumptions and scenarios, we observe that allowing for a *Global super grid* consistently results in decreased investments in solar power, even with transmission grids spanning 18 time zones. These results indicate that a *Global super grid*, as envisioned by OSOWOG, may not serve as an efficient tool to stimulate the deployment of solar power.

### CRedit authorship contribution statement

**Xiaoming Kan:** Conceptualization, Methodology, Formal analysis, Investigation, Writing – original draft, Writing – review & editing. **Fredrik Hedenus:** Conceptualization, Methodology, Writing – review & editing, Supervision, Funding acquisition. **Lina Reichenberg:** Conceptualization, Methodology, Writing – review & editing, Supervision, Funding acquisition.

### Declaration of competing interest

The authors declare the following financial interests/personal relationships which may be considered as potential competing interests: Xiaoming Kan, Fredrik Hedenus, and Lina Reichenberg report that financial support was provided by the Swedish Energy Agency. They declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

### Acknowledgements

The authors thank Christian Azar for helpful discussions and suggestions. This work was supported by the Swedish Energy Agency.

### Appendix A. Supplementary data

Supplementary data to this article can be found online at <https://doi.org/10.1016/j.rser.2024.115272>.

### Data availability

I have shared the link to my data and code in the manuscript.

### References

- IRENA, Renewable Power Generation Costs in 2021. International Renewable Energy Agency: Abu Dhabi 2022.
- Bogdanov D, Breyer C. North-East Asian Super Grid for 100% renewable energy supply: optimal mix of energy technologies for electricity, gas and heat supply options. *Energy Convers Manag* 2016;112:176–90.
- Breyer C, et al. On the techno-economic benefits of a global energy interconnection. *Economics of Energy & Environmental Policy* 2020;9(1):83–102.
- Brown T, et al. Synergies of sector coupling and transmission reinforcement in a cost-optimised, highly renewable European energy system. *Energy* 2018;160:720–39.
- Kan X, Hedenus F, Reichenberg L. The cost of a future low-carbon electricity system without nuclear power—the case of Sweden. *Energy* 2020;195:117015.
- Reichenberg L, et al. The marginal system LCOE of variable renewables – evaluating high penetration levels of wind and solar in Europe. *Energy* 2018;152:914–24.
- Rogelj J, et al. Scenarios towards limiting global mean temperature increase below 1.5 C. *Nat Clim Change* 2018;8(4):325–32.
- Van Vuuren DP, et al. Alternative pathways to the 1.5 C target reduce the need for negative emission technologies. *Nat Clim Change* 2018;8(5):391–7.
- Parida B, Iniyas S, Goic R. A review of solar photovoltaic technologies. *Renew Sustain Energy Rev* 2011;15(3):1625–36.
- ISA. About OSOWOG initiative [cited 2023 12-17]; Available from: <https://isolaralliance.org/work/osowog/>; 2023.
- Wikipedia. Green grids initiative — one sun. One World, One Grid; 2021 [cited 2023 12-17]; Available from: [https://en.wikipedia.org/wiki/Green\\_Grids\\_Initiative\\_%E2%80%94\\_One\\_Sun,\\_One\\_World,\\_One\\_Grid#cite\\_note-1-4](https://en.wikipedia.org/wiki/Green_Grids_Initiative_%E2%80%94_One_Sun,_One_World,_One_Grid#cite_note-1-4).
- Green grids initiative - one sun one world one grid: one sun declaration. [:/webarchive.nationalarchives.gov.uk/ukgwa/20230106144941/https://ukcop26.org/one-sun-declaration-green-grids-initiative-one-sun-one-world-one-grid/](https://web.archive.nationalarchives.gov.uk/ukgwa/20230106144941/https://ukcop26.org/one-sun-declaration-green-grids-initiative-one-sun-one-world-one-grid/); ; 2021.
- Sun One, World One. One Grid: India-UK's ambitious global solar grid plan explained. *Indiana* 2021.
- Aghahosseini A, et al. Analysing the feasibility of powering the Americas with renewable energy and inter-regional grid interconnections by 2030. *Renew Sustain Energy Rev* 2019;105:187–205.
- Bogdanov D, et al. Integrated renewable energy based power system for Europe, Eurasia and MENA regions. In: 2016 international energy and sustainability conference (IESC). IEEE; 2016.
- Reichenberg L, et al. Deep decarbonization and the supergrid—Prospects for electricity transmission between Europe and China. *Energy* 2022;239:122335.
- Prol JL, et al. Potential gains of long-distance trade in electricity. *Energy Econ* 2023:106739.
- Guo F, et al. Implications of intercontinental renewable electricity trade for energy systems and emissions. *Nat Energy* 2022:1–13.
- Brinkerink M, Gallachóir BÓ, Deane P. A comprehensive review on the benefits and challenges of global power grids and intercontinental interconnectors. *Renew Sustain Energy Rev* 2019;107:274–87.
- Rodríguez RA, Becker S, Greiner M. Cost-optimal design of a simplified, highly renewable pan-European electricity system. *Energy* 2015;83:658–68.
- Schlachtberger DP, et al. The benefits of cooperation in a highly renewable European electricity network. *Energy* 2017;134:469–81.
- Chatzivasilieadis S, Ernst D, Andersson G. The global grid. *Renew Energy* 2013;57:372–83.
- Grossmann WD, Grossmann I, Steininger KW. Solar electricity generation across large geographic areas, Part II: a Pan-American energy system based on solar. *Renew Sustain Energy Rev* 2014;32:983–93.
- Kuwano Y. The PV Era is coming—the way to GENESIS. *Sol Energy Mater Sol Cell* 1994;34(1–4):27–39.
- Mircea A, Philip M. A China-EU electricity transmission link: Assessment of potential connecting countries and routes 2017.
- Rudenko Y, Yershevich V. Is it possible and expedient to create a global energy network? *Int J Global Energy Issues* 1991;3(3):159–65.
- Grossmann W, Grossmann I, Steininger KW. Solar electricity supply isolines of generation capacity and storage. *Proc Natl Acad Sci USA* 2015;112(12):3663–8.
- Grossmann WD, Grossmann I, Steininger KW. Distributed solar electricity generation across large geographic areas, Part I: a method to optimize site selection, generation and storage. *Renew Sustain Energy Rev* 2013;25:831–43.
- Polzin F, et al. The effect of differentiating costs of capital by country and technology on the European energy transition. *Climatic Change* 2021;167(1):1–21.
- Schyska BU, Kies A. How regional differences in cost of capital influence the optimal design of power systems. *Appl Energy* 2020;262:114523.
- Ameli N, et al. Higher cost of finance exacerbates a climate investment trap in developing economies. *Nat Commun* 2021;12(1):1–12.
- IRENA. Renewable Power Generation Costs in 2020 2020.
- Mattsson N, et al. An autopilot for energy models—Automatic generation of renewable supply curves, hourly capacity factors and hourly synthetic electricity demand for arbitrary world regions. *Energy Strategy Rev* 2021;33:100606.
- IRENA. Future of wind: Deployment, investment, technology, grid integration and socio-economic aspects 2019.
- IRENA. Future of solar photovoltaic: deployment, investment, technology, grid integration and socio-economic aspects. *A Global Energy Transformation* 2019.
- Steffen B. Prospects for pumped-hydro storage in Germany. *Energy Pol* 2012;45:420–9.
- Hagspiel S, et al. Cost-optimal power system extension under flow-based market coupling. *Energy* 2014;66:654–66.
- Kalair A, Abas N, Khan N. Comparative study of HVAC and HVDC transmission systems. *Renew Sustain Energy Rev* 2016;59:1653–75.
- Purvis A, et al. Submarine power cable between Europe and North America: a techno-economic analysis. *J Clean Prod* 2018;186:131–45.
- Alassi A, et al. HVDC transmission: technology review, market trends and future outlook. *Renew Sustain Energy Rev* 2019;112:530–54.
- Cole WJ, Frazier A. Cost projections for utility-scale battery storage. *Golden, CO (United States): National Renewable Energy Lab.(NREL)*; 2019.
- Schlachtberger DP, et al. Cost optimal scenarios of a future highly renewable European electricity system: exploring the influence of weather data, cost parameters and policy constraints. *Energy* 2018;163:100–14.
- Hedenus F, et al. Wind Power Potentials in Models—A Gis Based Reality Check 2022.
- Copernicus C. ERA: Fifth generation of ECMWF atmospheric reanalyses of the global climate 2018.
- Badger J, et al. Wind atlas trends. In: DTU international energy report 2021: perspectives on wind energy. DTU Wind Energy; 2021. p. 25–33.
- Byers L, et al. A global database of power plants. *Washington, DC: World Resources Institute*; 2019. available at: <https://www.wri.org/publication/global-database-power-plants>. [Accessed 26 August 2020].
- Gernaat DE, et al. High-resolution assessment of global technical and economic hydropower potential. *Nat Energy* 2017;2(10):821–8.

- [48] Lehner B, et al. Global reservoir and dam database, version 1 (GRanDv1): Dams, revision 01 2016.
- [49] IEA. IEA energy statistics. cited 2020 March15, <https://www.iea.org/statistics/>; 2020.
- [50] Riahi K, et al. The shared socioeconomic pathways and their energy, land use, and greenhouse gas emissions implications: an overview. *Global Environ Change* 2017; 42:153–68.
- [51] Friedman JH. Greedy function approximation: a gradient boosting machine. *Ann Stat* 2001:1189–232.
- [52] Commission E. Communication from the commission to the European parliament, the council, the European economic and social committee and the committee of the regions youth opportunities initiative. European Commission Brussels, Belgium; 2011.
- [53] Van Zuijlen B, et al. Cost-optimal reliable power generation in a deep decarbonisation future. *Appl Energy* 2019;253:113587.
- [54] Steffen B. Estimating the cost of capital for renewable energy projects. *Energy Econ* 2020;88:104783.
- [55] Mirlletz B, et al. Annual technology baseline: the 2023 electricity update. Golden, CO (United States): National Renewable Energy Laboratory (NREL); 2023.
- [56] Steffen B, Waidelich P. Determinants of cost of capital in the electricity sector. *Progress in Energy* 2022;4(3):033001.
- [57] Damodaran A. Country risk: determinants, measures and implications-The 2021 Edition. Measures and Implications-The 2021.
- [58] Zhuo Z, et al. Cost increase in the electricity supply to achieve carbon neutrality in China. *Nat Commun* 2022;13(1):3172.
- [59] Hojckova K, Ahlborg H, Sandén BA. A global super-grid: sociotechnical drivers and barriers. *Energy, Sustainability and Society* 2022;12(1):1–16.