



Combustion of cables used in nuclear power plants

Downloaded from: <https://research.chalmers.se>, 2026-07-17 03:07 UTC

Citation for the original published paper (version of record):

Börjesson Sandén, F., Karkela, T., Kajolinna, T. et al (2026). Combustion of cables used in nuclear power plants. *Journal of Nuclear Science and Technology*, 63(7): 807-823.
<http://dx.doi.org/10.1080/00223131.2025.2609925>

N.B. When citing this work, cite the original published paper.



Combustion of cables used in nuclear power plants

Fredrik Börjesson Sandén, Teemu Kärkelä, Tuula Kajolinna, Anna-Elina Pasi & Christian Ekberg

To cite this article: Fredrik Börjesson Sandén, Teemu Kärkelä, Tuula Kajolinna, Anna-Elina Pasi & Christian Ekberg (2026) Combustion of cables used in nuclear power plants, Journal of Nuclear Science and Technology, 63:7, 807-823, DOI: [10.1080/00223131.2025.2609925](https://doi.org/10.1080/00223131.2025.2609925)

To link to this article: <https://doi.org/10.1080/00223131.2025.2609925>



© 2026 The Author(s). Published by Informa UK Limited, trading as Taylor & Francis Group.



Published online: 28 Jan 2026.



Submit your article to this journal [↗](#)



Article views: 311



View related articles [↗](#)



View Crossmark data [↗](#)



RESEARCH ARTICLE



Combustion of cables used in nuclear power plants

Fredrik Börjesson Sandén^a, Teemu Kärkelä^b, Tuula Kajolinna^b, Anna-Elina Pasi^c and Christian Ekberg^a

^aDepartment of Nuclear Chemistry, Chalmers University of Technology, Gothenburg, Sweden; ^bDepartment of Severe accident analysis (BA4503), VTT Technical Research Centre of Finland Ltd, Espoo, Finland; ^cFortum Nuclear Services (Operating plant and waste services), Fortum, Espoo, Finland

ABSTRACT

The combustion and subsequent reactions of cables found in nuclear power plants are investigated, including chlorosulfonated cables (CSPE cables) and a Low-smoke zero-halogen cables (LSZH cables). In some cases, the cables are irradiated with 1MGy of gamma radiation before combustion. Iodine is added to the gas phase to investigate the potential formation of organic iodides. The combustion process can be followed online with the help of FTIR. The combustion of the CSPE cable mainly releases HCl, SO₂ and CS₂ and aliphatic hydrocarbons. If the cables are pre-irradiated, the species released are largely the same, but the releases are lower. The LSZH cable required higher temperatures to pyrolyze and gave significant releases of acetaldehyde. This cable was not irradiated. The addition of iodine results in the formation of methyl iodide (CH₃I) for the LSZH cable at 450°C. CH₃I also reacts with other organics released in the combustion, forming isopropanol. The same happens for the unirradiated CSPE cable, but to a much lower degree.

ARTICLE HISTORY

Received 12 August 2025
Accepted 17 December 2025

KEYWORDS

Cables; combustion; nuclear power plant; organic iodide

1. Introduction

A severe nuclear accident is characterized by the release, or the potential for release, of radioactive material from the containment. This makes the radio nuclides themselves vital to study and several such studies focusing on different radionuclides are available [1–8]. However, these studies focus mainly on the direct release of the radionuclides from the source term. In a more realistic case, there will also be other chemical compounds that any released radionuclides can react with. These include organics from paints and cables, and other metals or structural materials. The products formed in these interactions can greatly affect the actual release patterns and thus, also, the total release of radionuclides during and after a severe accident.

An important group of components (with potential impact on the evolution of accident the chemistry) is electric cables. Cable jacket materials make up the outer surface of cables exposed to prevailing conditions in NPP and is thus predominantly available for chemical reactions. Cable jacket materials differ between nuclear power plant, depending on the national legislation and year of construction/refurbishment of the power plant in question.

This paper aims to investigate the organic species released by the combustion of cables in the reactor containment. These include chloro-sulfonated polyethylene (CSPE) cables, both fresh cable and cable

subjected to irradiation. Similarly, a low-smoke zero-halogen (LSZH) cable are investigated. In this instance, only a fresh cable is investigated. These cable types are representative of, respectively, the Swedish BWR-type nuclear power plants (NPPs) Forsmark and Ringhals [9], and a new, French EPR-type NPP. Special interest falls on any interactions between the released combustion products and iodine.

2. Background

2.1. Iodine chemistry in a severe nuclear accident

During an accident, the engineered safety systems will likely be triggered. These include the containment spray system, used to wash down any aerosols formed from the gas phase and into the water sump at the bottom of the containment. The spray solution is alkaline (pH ca. 9.3 [10]) but also contains boric acid. The alkaline pH retains the fission product iodine dissolved as I[−], with boron added due to its neutron-absorbing properties.



Iodine is one of the most significant fission products from a radio-hazard point of view. In a severe accident, iodine predominantly tends to form cesium iodide, CsI (cesium being another fission product) [11]. CsI exists as an aerosol and is effectively washed down into the sump by the containment spray system [12]. However, in a real accident, there is potential for radiation-induced reactions which may (re)form iodine [13] or

lead to the formation of organic iodides [14], some of which are volatile.

A few per cent of iodine can also be expected to exist in the gas phase as I_2 , rather than CsI . I_2 is not expected to react thermally with O_2 or N_2 [15] (though the presence of radiation may affect this). During an accident however, organic iodides, such as methyl iodide CH_3I , can be formed from the interaction between volatile iodine and the organics released from containment paint due to radiolysis [16]. These species are even more volatile than I_2 and similarly radiotoxic.

The exchange of iodine between the gas and liquid phases may be described as Reaction 1. This is a purely physical phenomena and does not involve any chemical reaction. While iodine gas is slightly soluble in water, its solubility is increased upon the addition of iodides in the aqueous phase, due to the formation of the highly soluble triiodide ion [15]. The rate of reaction 2 (the forward reaction) is very fast, $6.2 \times 10^9 \text{ M}^{-1}\text{s}^{-1}$ [17], meaning that this reaction can effectively capture any dissolved I_2 . Reaction 3 May also contribute to the dissolution of iodine but the extent depends on the pH. The more alkaline the system, the more important Reaction 3 becomes [15].

Reaction 2 requires iodide in the aqueous phase. In an accident this is supplied by, say, washed-down CsI .



Direct interaction between volatile organics and iodine in the gas phase of the containment could be theoretically possible due to radiolysis, but the low concentration of both iodine and organics makes it this unlikely [13]. To further limit this possibility, the organic radicals are likely to react with ambient oxygen [14]. Likewise, a thermal reaction between organics and iodine resulting in organic iodides is possible but only at temperatures beyond what may be expected in the containment (400–500°C for the reaction between

methane and iodine) [14]. These temperatures may be reached locally, however, in which case the reaction may become significant.

2.2. Chlorosulfonated polyethylene (CSPE)

CSPE (also known by the brand name 'Hypalon') cables are used in nuclear power plants due to their good resistance to ageing, chemical degradation and high temperatures (remaining intact up to 130°C, or more for a limited time) [18,19]. The use of this type of cable has been well documented in terms of mechanical properties after ageing [19,20] and irradiation [21,22]. However, combustion of these cables, especially in terms of their chemical releases, is less well-studied.

CSPE is not a homogenous compound but a class of polymers; their exact composition with respect to chlorine and sulfone content will vary depending on the intended use, production method and time of production. Furthermore, factors such as crosslinking, additives, fillers and chain length are all properties that are likely to change which, in turn, changes the material properties. However, all CSPE polymers are formed by polyethylene with a portion of the hydrogen atoms replaced by either chlorine or sulfonyl chloride. Typical contents are about 25–43% chlorine and 0.8–1.5% sulfur (by weight) [23,24]. The chlorination/sulfonation of polyethylene typically results in a random replacement of hydrogen atoms, which also affects the material. The polymer is typically not made up of discrete chlorinated/sulfonated blocks.

CSPE consists of three different monomer types: ethylene, ethyl chloride and ethyl sulfonyl chloride. Depending on the sulfur and chlorine content, the ratio between these will differ for different batches of CSPE. Figure 1 gives a schematic representation of a polymer with typical ratios.

2.3. LSZH cables

LSZH cables are electrical cables designed to emit a limited amount of smoke and halogenated compounds when they burn, typically by making use of hydrated inorganic fillers. These hydrated fillers produce water vapor upon heating, cooling the

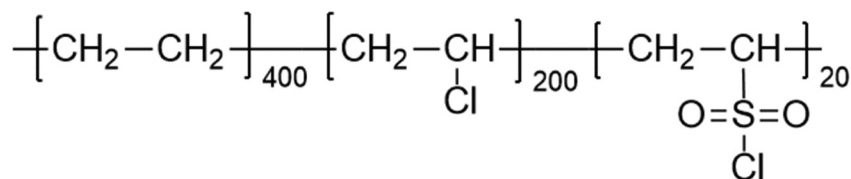


Figure 1. Schematic structure of CSPE. Note that the numbers of the different groups are typical values, liable to differ somewhat between samples and manufacturers.

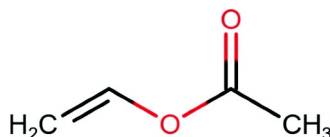


Figure 2. Structure of vinyl acetate. Polyvinyl acetate is very likely used in the LSZH cable.

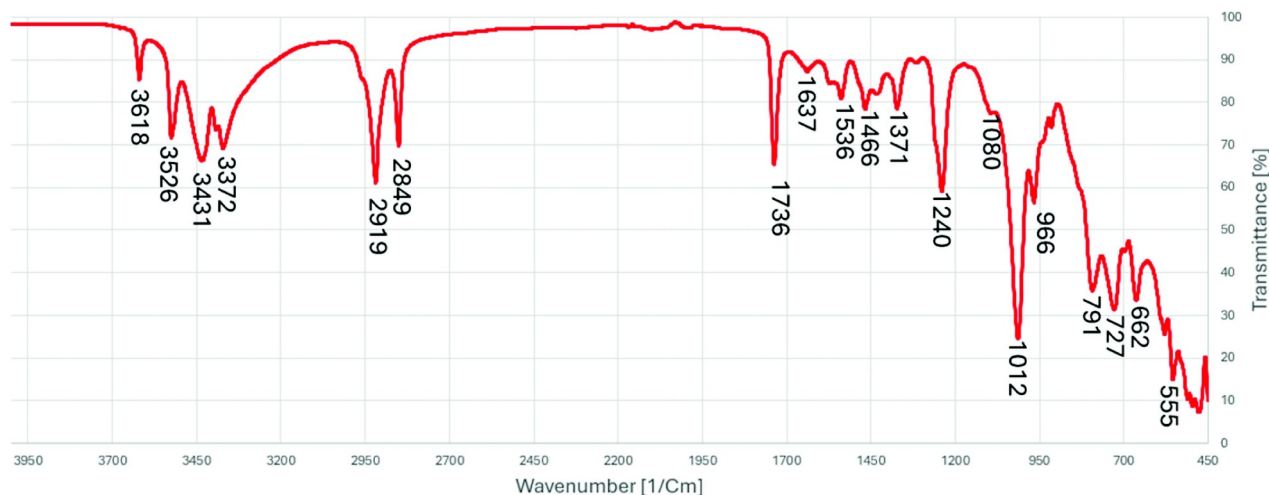


Figure 3. FTIR-ATR spectrum of the LSZH cable. All major layers gave similar results.

combustion reaction and slowing further degradation of the cable. The exclusion of halogens makes for a less toxic fire and simplifies evacuation and firefighting. Chemically, LSZH cables are not one type of material but a classification of cable jacketing materials. Due to its different chemical makeup, an LSZH cable releases different compounds when it burns compared to a CSPE one. The exact chemical makeup used for the cables investigated here has not been conclusively determined, but from the original patent [25] of LSZH cables, (poly)alkenes and (poly)vinyl acetate are mentioned specifically. The structure of vinyl acetate is depicted in [Figure 2](#).

FTIR-ATR was conducted on the LSZH cable, and the resulting spectrum can be seen in [Figure 3](#). The different layers all give very similar spectra. Compared to a reference of a polyethylene-polyvinyl acetate blend, several signals correspond well [26] (most importantly the carbonyl group at 1736 cm^{-1} , and the C-O groups at 1240 and 1012 cm^{-1}), though not all. The outstanding signals are thought to be because the cable likely contains further additives than the pure material (like inorganic filler).

Cable characteristics for both the CSPE cable and the LSZH cable can be found in [Table 1](#).

3. Methods and experiments

3.1. Cable samples

In total, three different cables were used for the basis of the combustion experiments. For the CSPE cables, a freshly purchased connection cable with a single sheet of isolating CSPE rubber around a copper core is used. It was determined that about 60% (by weight) of the cable was jacket material.

The second cable was the same as the first but subjected to 1 MGy gamma irradiation over the course of 15 days. The irradiation took place in a Gammacell 220 (MDS Nordion, Atomic Energy of Canada Ltd.), at a temperature of about $30\text{--}35^\circ\text{C}$ and under a continuous (slow) flow of N_2 gas to purge any evolved HCl. The dose rate was about 45 Gy/min . The material, when compared to the fresh, unirradiated cable, appeared relatively unchanged, though it was stiffer. No change in the mass could be detected compared to the unirradiated material.

The third cable was a fresh LSZH cable. This cable was much more complex in its composition, having a total of seven layers, though only three were expected to contribute in a major way to the combustion. From the outside going inwards, there

Table 1. Technical details of the cables investigated.

	CSPE Cable	LSZH cable
Supplier	Belden	Nexans
Maximum voltage [V]	600	600
Maximum operating temperature [$^\circ\text{C}$]	105	60
Conductor material	Tinned copper	Copper
Number of conductors	1	3
Cable diameter [mm]	3.9	11.4

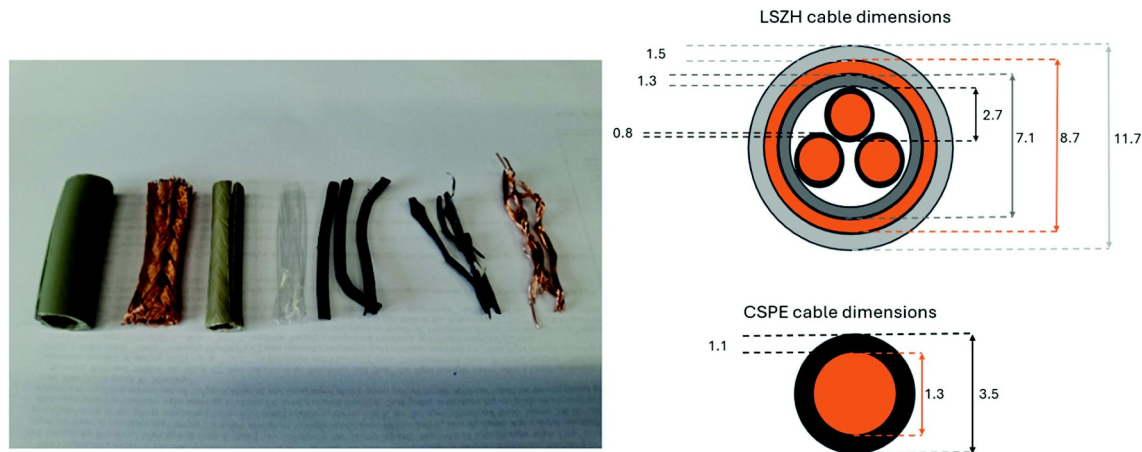


Figure 4. Dimensions of the cable layers for the LSZH and CSPE cables (all numbers in millimeter). To the left a photo of the LSZH cable layers. Note that layers four and six (counted from the right) on the photo are omitted from the figure (they are too thin to measure reliably and have no practical bearing on the dimensions).

is first an outer layer (1.5 mm thick, outer radius 11.7 mm), followed by a copper-wire mesh. The second layer (1.3 mm thick, outer radius, 7.1 mm) covers a bundle of three individual cables (0.8 mm thick, outer radius ca. 2.7 mm), each with a copper conductor core. These three cables are also surrounded by a thin sheet of plastic and the conductor core is bound together by a thin polymeric layer. The layers and schematics of this cable are depicted in Figure 4. In total, 61% of the weight is made up of polymers and 39% is metallic copper.

3.2. Experiment conditions

Combustion requires oxygen and so the atmosphere for these tests was synthetic air (21% O₂, 79% N₂, AGA). Three temperatures (200°C, 300°C and 450°C) were investigated to get as complete a picture of the combustion process as possible. These temperatures were chosen to be different enough to capture any significant difference in the combustion processes, whilst being high enough to ensure significant combustion.

In a real nuclear accident, as explained above, steam can be expected to be part of the atmosphere. However, this paper omits steam to focus on the combustion reaction releases themselves and avoid condensation inside the system, as this could interfere with the FTIR measurement by ‘washing’ out any organic compounds. The combustion reaction itself produces some water but not enough to cause any significant issues.

3.3. Experimental setup and matrix

The experiments were conducted using a tubular furnace (Entech Vecstar, VCTF 4) with a stainless-steel tube (AiSi 316 L). The cable sample was placed in an Al₂O₃ crucible, and the liquid trap was made

of borosilicate glass. Synthetic air (21% O₂, 79% N₂) was fed into the furnace at a rate of 2.5 L/min, controlled by a mass-flow control unit (Brooks S5851, Brooks® Instruments). I₂ is generated from solid iodine crystals placed in a container and volatilized by a 65°C water bath. The schematic setup is shown in Figure 5.

The furnace outflow was directed through two different channels. Each experiment involved online measurement using Fourier-transformed infra-red spectrometry (FTIR, Gaset Technologies Oy) of the exhaust (1.5 L/min). The remaining 1 L/min was directed to exhaust, or, when iodine was connected to the system, through a liquid trap (150 ml 0.1 M NaOH) to capture any unreacted I₂.

In front of the FTIR, there was a filter (47 mm, Millipore, PTFE/Teflon) to prevent particulate matter from contaminating the FTIR. The experimental matrix can be seen in Table 2.

A total of 48 experiments were conducted, investigating the three cables across the three temperatures (200, 300 and 450°C), with and without the presence of iodine. 24 experiments were conducted without iodine to establish a reference for the temperatures. The remaining experiments involved gaseous iodine being fed into the system. Note that for the experiments at 450°C, only duplicates were made, whereas for the rest the experiments were triplicated to ensure calculation of the standard deviation.

The duration of experiments depended on the temperatures. For 200°C and 300°C, each experiment lasted 30 minutes. For 450°C, higher releases were expected, and the duration was increased to 60 minutes.

The experiments were performed by placing the sample in an alumina crucible and pushing the crucible into the furnace hot zone after it had reached the

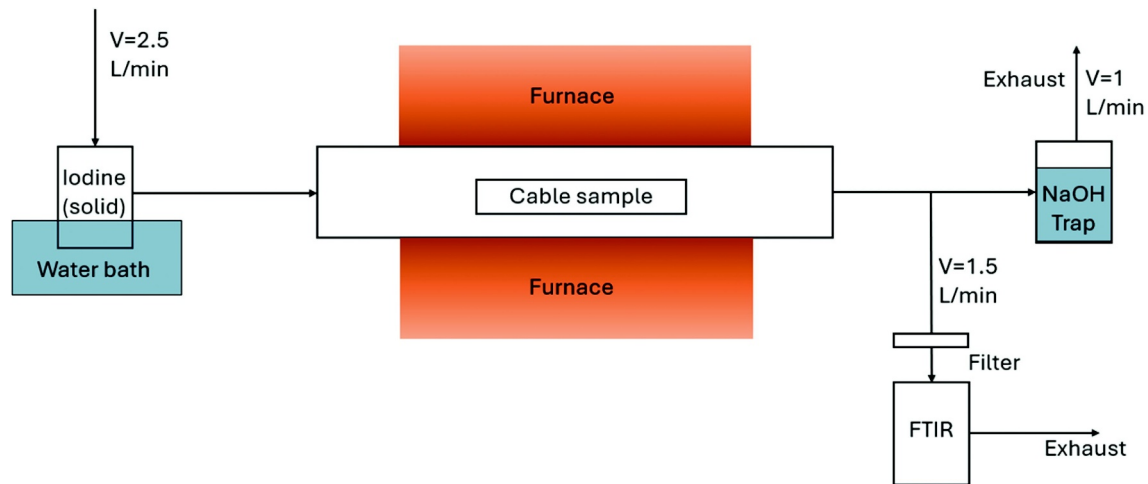


Figure 5. Schematic representation of the system used for the experiments with iodine. The initial water bath and liquid trap were disconnected for the experiments without iodine.

Table 2. Experimental matrix.

Cable designation	Temperature [°C]	Iodine presence	Duration [min]	No. of repeats
Fresh CSPE	200	No	30	3
Fresh CSPE	300	No	30	3
Fresh CSPE	450	No	60	2
Irradiated CSPE	200	No	30	3
Irradiated CSPE	300	No	30	3
Irradiated CSPE	450	No	60	2
LSZH	200	No	30	3
LSZH	300	No	30	3
LSZH	450	No	60	2
Fresh CSPE	200	Yes	30	3
Fresh CSPE	300	Yes	30	3
Fresh CSPE	450	Yes	60	2
Irradiated CSPE	200	Yes	30	3
Irradiated CSPE	300	Yes	30	3
Irradiated CSPE	450	Yes	60	2
LSZH	200	Yes	30	3
LSZH	300	Yes	30	3
LSZH	450	Yes	60	2

targeted temperature (the samples were not subject to the gradual heating of the furnace). The samples were roughly 6 g of cable, in the case of the Fresh CSPE and the LSZH cable and 4 g in the case of the irradiated CSPE. The cables were used as received, with no further preparation.

For the experiments involving iodine, the liquid traps were changed between each experiment. For the experiments at 200°C and 300°C, the same trap was used for the entire 30 minutes. For those at 450°C, the liquid trap was changed every 15 minutes. This was done to avoid saturating the trap, as longer experiments would result in more total iodine being fed in. By changing the trap every fifteen minutes, it was possible to track the change in iodine throughput for these experiments.

Finally, the iodine flow through the system was measured at 300°C, with no cable sample present. This was done to establish a reference iodine mass flow rate. The experiment was conducted by taking samples of the liquid trap after five, 10, 15 and 20 minutes of iodine flow.

4. Results

This chapter presents the important results of the study. However, the majority of the discussion of the results can be found in Chapter 5 ('Discussion').

4.1. Filter mass change

The filter in front of the FTIR was weighed before and after each experiment using a bench scale capable of measuring to hundreds of micrograms.

The filter weight measurements (mass accumulation on filter) for the different experiments can be seen in Figure 6.

Figure 6 implies that the presence of iodine affects the combustion, especially at the highest temperature where all experiments in which iodine is present result in a heavier filter. In these experiments, the mass accumulation on the filters at 200°C is low and no conclusions can be drawn, other than that the evolution of soot particles at this temperature is limited. At 300°C, the presence of iodine makes a small difference in filter weight for all samples. The exception was the fresh CSPE cable, where the filter in which iodine was not present was more than three times as heavy as the one with it. At 450°C, the experiments with iodine always gave a heavier filter than the experiments without it. The reasons for this are uncertain but some observations can be made.

Iodine does not interact with the filter material (Teflon) to any significant extent (as evidenced by the fact that no fluorine compounds are ever detected in the FTIR, implying that the filter material remains intact). An alternative explanation is that iodine results in the formation of more/other species compared to the system without iodine. For the LSZH cable, the FTIR supports this.

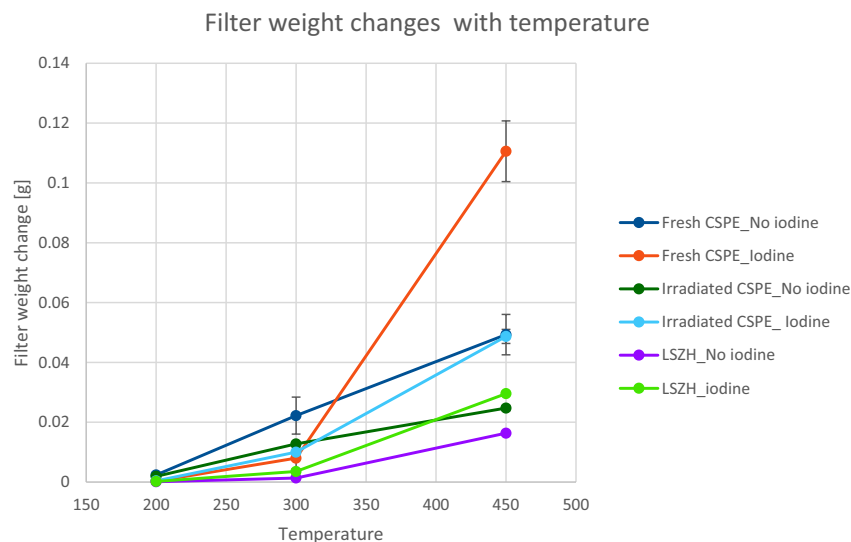


Figure 6. Mass accumulation on filter for the different temperatures and cables in the experiments. Note that, in all cases, the presence of iodine gives a heavier filter at 450°C (but also note that some of the ranges are smaller than the points).

Iodine may also interact with the soot on the filter as the iodine gas passes through it, either reacting or simply being retained in the organic residue from the combustion. Especially in the case of the fresh CSPE, the filter deposit consisted partly of an oily liquid. As I_2 is non-polar, it may be retained in organic liquids. This may partially explain the increase in filter weight.

In terms of mass accumulation on the filters without an iodine feed, the order of releases (in descending order) is fresh CSPE, irradiated CSPE and finally the LSZH cable. This is largely in agreement with the FTIR analysis, in which the LSZH cable tended to measure low concentrations of combustion products. This could be expected, as these cables are explicitly designed to produce little smoke.

4.2. Liquid trap analysis

The iodine contents of the liquid traps were analyzed by inductively coupled plasma mass

spectrometry (ICP-MS ICAP-Q, Element 2 Thermo Scientific). The samples were diluted 10,000 times in 0.5% ammonia with 1ppb of cobalt ($K_3Co(CN)_6$) as the internal standard. Br^- was also investigated as an internal standard but no significant difference was found between it and $K_3Co(CN)_6$. The system was flushed with ammonia between each sample measurement.

The results of the reference experiments (with no cable present) are shown in Figure 7. Based on the extrapolation, 30 minutes' sampling at 300°C would result in an iodine concentration of about 2.75mmolar.

Table 3 summarises the iodine concentration in the liquid traps after 30 minutes' sampling for the respective low-temperature experiments.

There are major uncertainties in these experiments. Thus, the values cannot be stated as deviating significantly from the reference experiment ($\pm$ two standard deviations) without cable material present.

Figure 8 shows the time-resolved data for the experiments at 450°C. As only duplicates are available

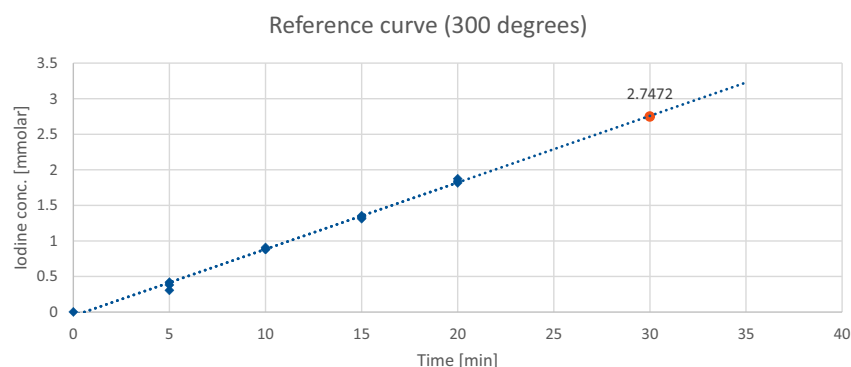


Figure 7. Resulting iodine concentration in the liquid trap after various iodine flushing times. Triplicates are plotted but are very close to each other.

Table 3. Iodine concentration (mean-value and standard deviations) in the liquid traps after 30 minutes' sampling in the experiments performed at 200°C and 300°C in the presence of cable materials. Because the experiments at 450°C are time-resolved and only available in duplicates, they are reported in Table 4.

	Fresh CSPE [mmolar iodine]	Irradiated CSPE [mmolar iodine]	LSZH [mmolar iodine]
200°C	2.2 ± 0.5	3.1 ± 0.9	2.7 ± 0.1
300°C	3.2 ± 0.7	3.9 ± 0.6	3.3 ± 0.4

for these experiments, it is impossible to calculate a standard deviation. However, the results for each pair of experiments often generally agree.

In this case, the liquid traps were changed every 15 minutes (compared to 30 minutes for the low-temperature cases). Thus, the concentration values are lower than in the low-temperature cases. Adding up the iodine fed throughout all the experiments at 450°C gives the total amount of iodine, as shown in Table 4.

At this temperature, both the fresh and irradiated CSPE cables behave similarly. Relatively little iodine is retained in the liquid trap in the first 15 minutes. However, after that, the concentration is steady and comparatively high. The LSZH cable has noticeably less iodine retained in the liquid trap. This might be expected based on the FTIR results, as a noticeable fraction of methyl-iodide forms under these circumstances. It is expected that methyl iodide is less retained by the liquid trap than I_2 .

The irradiated CSPE cable consistently shows the most iodine in the liquid trap. This cable is also the one that consistently gives the lowest concentration of organics in the FTIR measurements. This means there are few organics to react with and form any methyl iodide and little organic residue in the system which might retain the iodine there.

4.2.1. A note on the mass-balance of iodine in the liquid trap

The vapor pressure of iodine at 40°C is about 100 Pa [15]. The volumetric flow of air into the system was 2.5 L/min, where 1 L/min was directed through the liquid trap. At ambient pressure (taken to 101,325 Pa), the total number of moles of iodine per minute entering the system can be calculated as in Equation 4 (assuming ideal gases):

$$\frac{n_I}{n_{tot}} = \frac{P_I}{P_{tot}} \rightarrow n_I = 9.6057 \times 10^{-5} \text{ moles/min} \quad (4)$$

where n_I is the number of moles of iodine, n_{tot} is the number of moles in total in the system, P_I is the partial pressure of the iodine and P_{tot} is the total pressure of the system.

In the 15 minutes during which the liquid trap is connected, this gives 1.44×10^{-3} moles in total to the system. If 1 L/min (40%) is directed through the trap and with each trap having a volume of 0.1 L each, that means the maximum concentration of the liquid trap would be 5.76 mM after 15 minutes, or 23.04 after 60 minutes. The numbers measured in the liquid trap are therefore below the theoretical maximum.

The remaining iodine is likely retained in the system pipes. As the temperature decreases from the hot zone in the furnace, some organic residue condenses into an oily liquid and is assumed to retain some iodine. Some iodine may also be able to escape the liquid trap, especially if in the form of organic iodides.

4.3. FTIR analysis

The combustion process was investigated with an online FTIR to determine the combustion products of the different cables at different temperatures and times. As might be expected, the lower temperatures gave very faint results. Only at 300°C and above were

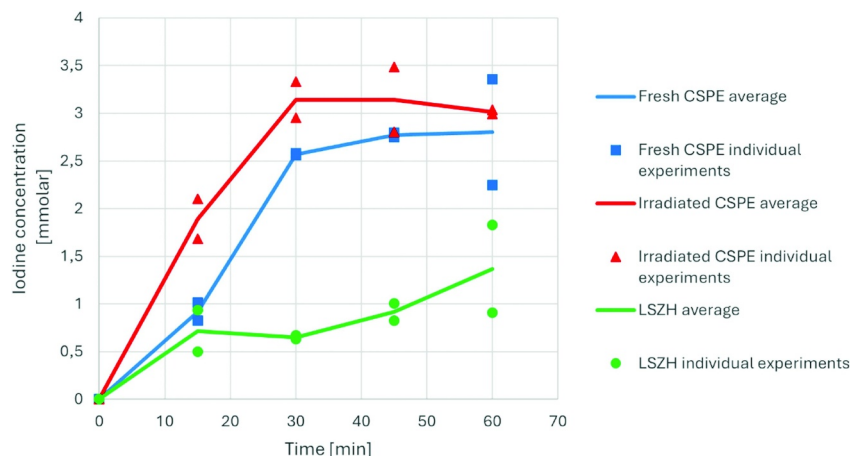


Figure 8. Iodine content of the liquid traps in the experiments taking place at 450°C. Note that the liquid traps were changed every 15 minutes, whereas in the low-temperature experiments this was done every 30 minutes. As such, the results of these experiments should not be directly compared.

Table 4. Iodine concentration (mean value) in the liquid traps after 30- and 60-minutes' sampling in the experiments performed at 450°C in the presence of cable materials.

	Fresh CSPE [mmolar iodine]	Irradiated CSPE [mmolar iodine]	LSZH [mmolar iodine]
30 min	3.5	5.0	1.4
60 min	9.1	11.2	3.7

the concentrations high enough to give meaningful results. Due to the reduced number of experiments at 450°C, no uncertainty estimation is presented for those experiments.

Analysis of the solid residue of the cables, while interesting, falls outside the scope of this paper and will not be further considered.

4.3.1. Low-temperature combustion of the fresh and irradiated CSPE cables

The main species for combustion at 300°C can be seen in Table 5. An example of an FTIR spectrum with the more relevant species can be seen in Figure 9 (fresh CSPE cable) and Figure 10 (irradiated CSPE cable).

As the CSPE cable contains both sulfur and chlorine it is expected that both these elements will be detected during combustion. CS₂ and SO₂ were released early in the combustion of the fresh CSPE cable and the release of CS₂ was followed by SO₂. The literature implies these species are released early/at a low temperature [27]. These releases appear to be more-or-less mutually exclusive, as the increase in SO₂ is always accompanied by a decrease in CS₂. SO₂ is present for a large portion of the combustion process. This behavior is related to the exposure of the cable interior, causing a sudden release of stored combustion products.

The most prevalent hydrocarbons are ethane (C₂H₆) and 1,3-butadiene (C₄H₆). As the basic building block of CSPE is polyethylene, ethane can be assumed to form from the breakdown of the polymer. The fact that some heavier hydrocarbons are also detected (such as hexane C₆H₁₄) supports this hypothesis. The formation of butadiene is attributed to the loss of chloride or SO₂Cl groups, giving an unsaturated compound. The general shape of the releases implies a stepwise combustion, in which the outer parts of the cable are burnt first, followed by

a decrease in combustion until the cable structure opens up and a 'burst' of combustion material is released.

When investigating the combustion of the irradiated cable, it is apparent that the same species as for the fresh cable appear relevant for this one. The main difference is that the releases are significantly lower for the irradiated cable; typically between one-third and half of the emitted species of the fresh cable. One difference is that C₄H₆ (1,3-butadiene) is not detected in the exhaust of the irradiated cable.

The addition of iodine causes a decrease in releases in both cases which may, at least partially, be explained by the fact that the addition of I₂ (which cannot be seen in the FTIR) dilutes the gas stream and decreases the concentration of all other species. No iodinated hydrocarbons can be measured in either case.

4.3.2. High-temperature combustion of the CSPE cables

At 450°C, many more species are detected and in higher concentrations. An example of the on-line FTIR measurement of the fresh cable is included in Figure 11 (no iodine present). For both repeats of this experiment, the measurements gave similar results in terms of what species were released and at what time. The same experiment with iodine included shows similar results but generally lower concentrations of all species and a slower overall process. An example of such an FTIR measurement can be seen in Figure 12.

The general shape of the releases is not unlike those present at 300°C. CS₂ and SO₂ are still present as a very early release and, again, CS₂ is released first and supplanted by SO₂. However, both are released early and not measured for long. Multiple organic species are also released over a brief timespan and either disappear after that or are released with some continuity. Acetaldehyde is consistently detected and presumably formed from the polyethylene [28].

Moreover, the organics released are similar to the experiments at 300°C, with mostly aliphatic hydrocarbons. The presence of CO is a difference compared to the lower temperature, however.

Upon adding iodine to the system, the general shape of the curve stays the same with a large, early release of HCl, CS₂ and SO₂. The most common

Table 5. Mean concentration of different species released by the fresh and irradiated CSPE cables at 300°C. The values listed are the means of the highest measured concentration in each of the three experiments.

Species	Combustion products without iodine [ppm]	Combustion products with iodine [ppm]	Combustion products without iodine [ppm]	Combustion products with iodine [ppm]
	Fresh CSPE		Irradiated CSPE	
CS ₂	30.3 ± 0.3	12.3 ± 4.8	2.3 ± 0.6	<2
SO ₂	32.3 ± 5.6	3.8 ± 3.0	13.2 ± 2.6	2.5 ± 0.8
HCl	50.9 ± 23.4	8.1 ± 3.2	21.1 ± 5.1	14.5 ± 1.6
C ₆ H ₁₄	4.3 ± 0.9	<2	4.0 ± 0.6	<2
C ₄ H ₆	45.0 ± 15.5	<2	15.2 ± 2.1	<2
C ₂ H ₆	22.7 ± 7.1	2.3 ± 0.2	11.2 ± 1.6	2.8 ± 0.8
C ₂ H ₄ O (acetaldehyde)	5.1 ± 2.1	<2	5.0 ± 1.2	<2

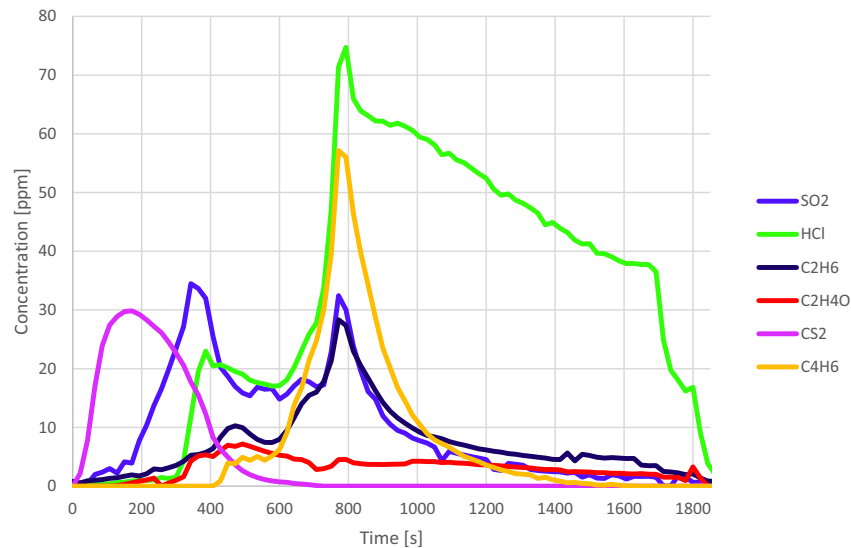


Figure 9. Online FTIR analysis results of a combustion process of the fresh CSPE cable at 300°C. Note that several other species were measured and detected but at very low concentrations. For clarity, only the most prominent species are plotted.

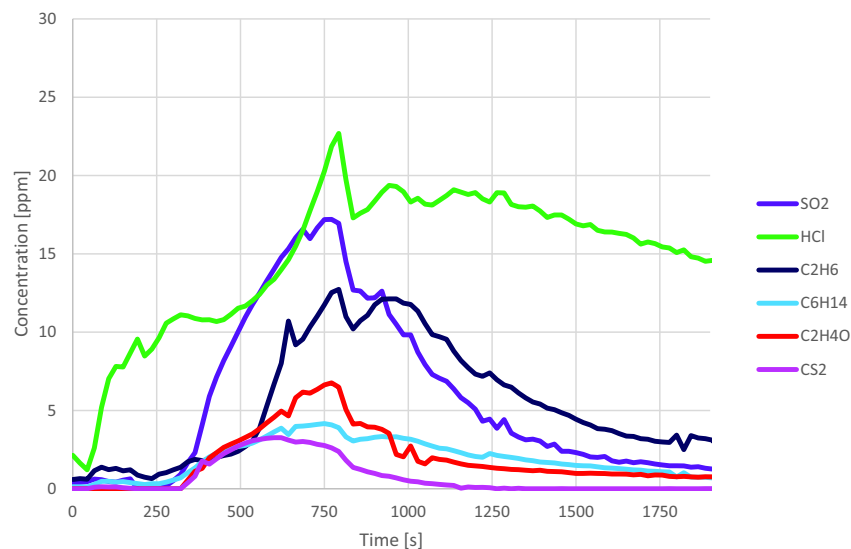


Figure 10. Online FTIR analysis results of a combustion process of the irradiated CSPE cable at 300°C. Note that several other species were measured and detected but at very low concentrations. For clarity, only the most prominent species are plotted.

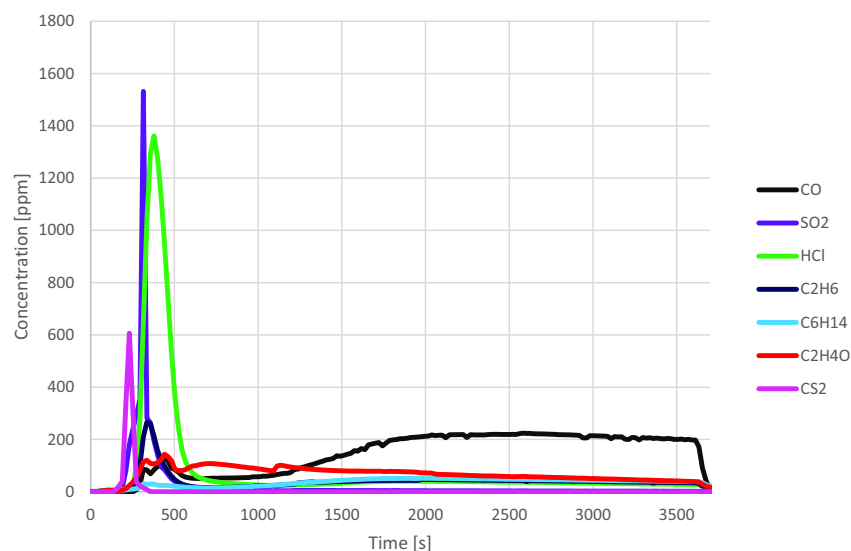


Figure 11. Online FTIR analysis results of the combustion of the fresh CSPE cable at 450°C. There is a significant release of combustion products in the first ca. 10 minutes, followed by a less intense release of, among other species, co.

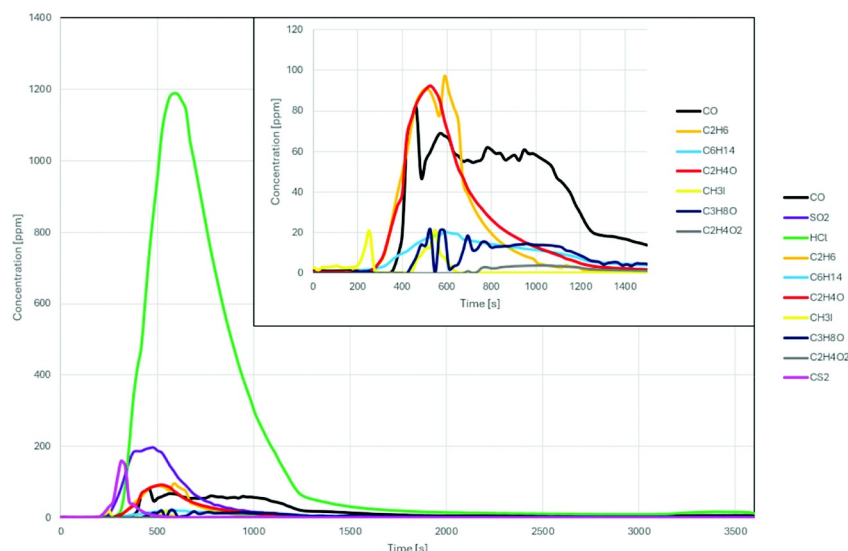


Figure 12. Online FTIR analysis results of a combustion process of the fresh CSPE cable at 450°C with iodine present. Again, there is a rapid release in the early parts of the combustion but, as opposed to the process without iodine, most of the combustion appears complete after about 1500 seconds (25 minutes). A few new species are also detected (see the cut-in image, where HCl, SO₂, and CS₂ have been omitted), including methyl iodide (CH₃I), acetic acid (C₂H₄O₂) and isopropanol (C₃H₈O).

hydrocarbon in the 300°C temperature experiment was 1,3-butadiene (C₄H₆). It is completely absent from the experiment at 450°C, presumably due to more efficient breakdown at the higher temperature. Also, interestingly, there are small releases of acetic acid, isopropanol, and methyl iodide. These species and the reactions forming them will be discussed further in section 5.3.

The irradiated cables behave very similarly to the non-irradiated ones, though the concentrations measured are noticeably lower. In particular, the concentrations of SO₂ and CS₂ have fallen significantly but most hydrocarbons have also decreased compared to the fresh cable.

The time-resolved experiment without iodine, as seen in Figure 13, shows that the general shape of the curve is very similar to that of the

fresh cable. Also, just as with the fresh cable, the previously common 1,3-butadiene cannot be measured.

For the case in which iodine is included in the combustion of the irradiated cable, the pattern is practically identical to the fresh one; lower overall concentrations (except for HCl) compared to the same process without iodine. An example of the process can be seen in Figure 14.

4.3.3. Low-temperature combustion of the LSZH cable

For the experiments at 200°C, all the releases were so low that no conclusions could be drawn, except to say that the cable seemed to be almost unaffected by this temperature, at least for the timeframe of these experiments.

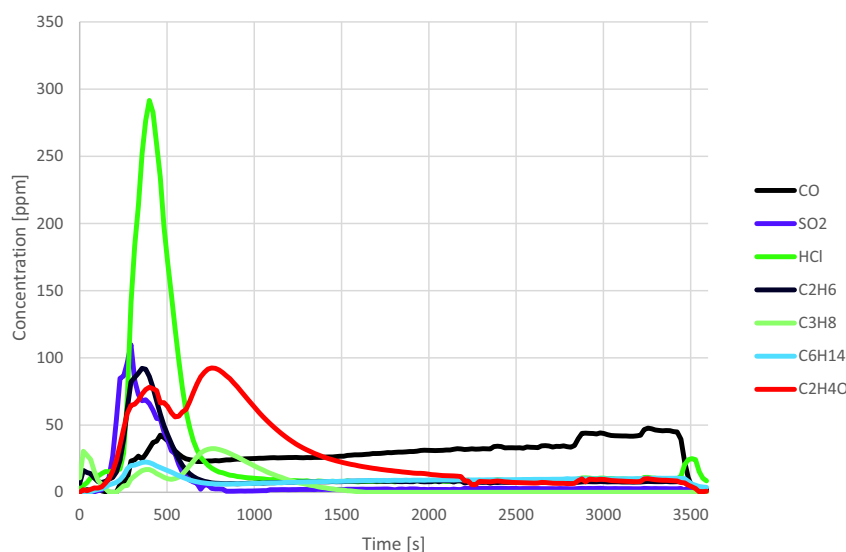


Figure 13. Online FTIR analysis results of a combustion process of the irradiated CSPE cable at 450°C. Note the similarities to Figure 11, aside from the scale on the y-axis.

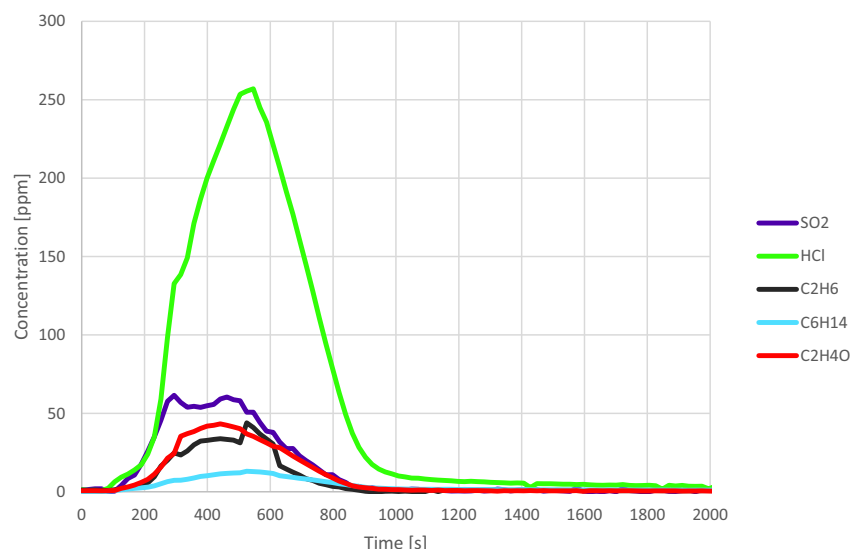


Figure 14. Online FTIR analysis results of a combustion process of the irradiated CSPE cable at 450°C with iodine. Note the similarities with Figure 12, aside from the scale on the y-axis.

Table 6. Concentration of different species released by the LSZH cable at 300°C. The values listed are the means of the highest concentration measured for each experiment.

Species	Mean concentration without iodine [ppm]	Mean concentration with iodine [ppm]
CO	4.2 ± 1.5	5.9 ± 1.3
C ₂ H ₄ O (acetaldehyde)	5.8 ± 1.5	4.8 ± 0.2
NO ₂	2.4 ± 0.2	<2
C ₂ H ₄ O ₂ (acetic acid)	<2	7.9 ± 2.1
C ₃ H ₈	<2	2.8 ± 0.5
CH ₃ I	<2	$2.6 \pm ?^*$

*CH₃I was only detected in two of the three experiments (at 4.19 and 3.56 ppm).

For the LSZH cable, only a few species appear in significant concentration during the combustion without iodine. They are presented in Table 6. All other species consistently measure below 2 ppm. The inclusion of iodine gives rise to several new species being measured

in relatively significant concentrations. Most noteworthy is acetic acid (C₂H₄O₂), which is the dominant species in this case. Furthermore, the inclusion of iodine did not cause a universal decrease in species compared to the case without it.

4.3.4. High-temperature combustion of the LSZH cable

The combustion profile for the LSZH cable is different from the CSPE cables. Acetaldehyde remains a core species of the process and the aliphatic hydrocarbons make up a small fraction of the combustion products compared to the case of the CSPE cables. One of the concentration measurements of gaseous releases is shown in Figure 15.

The general shape of the releases is different from those of the CSPE cables. The LSZH cable has a longer-running process. Species are measured at

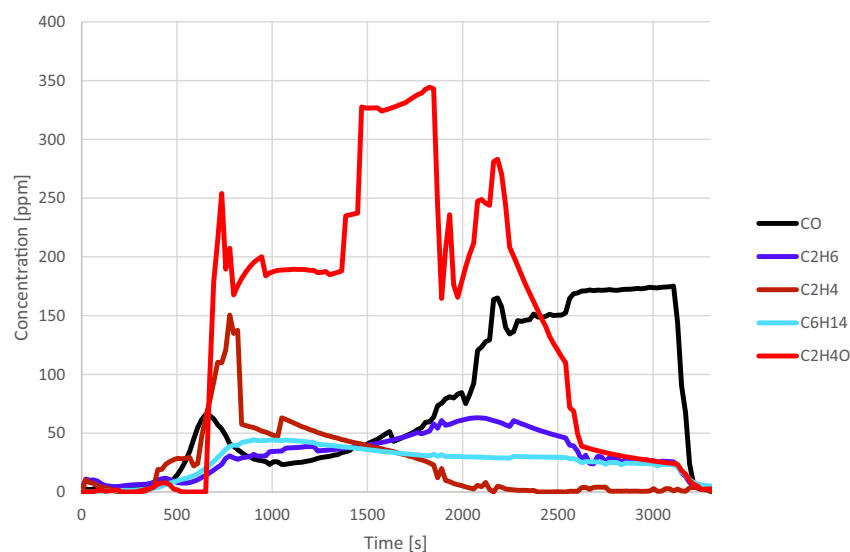


Figure 15. Online concentration analysis of a combustion process of the LSZH cable at 450°C. The process is dominated by acetaldehyde (C₂H₄O) with smaller contributions from aliphatic hydrocarbons.

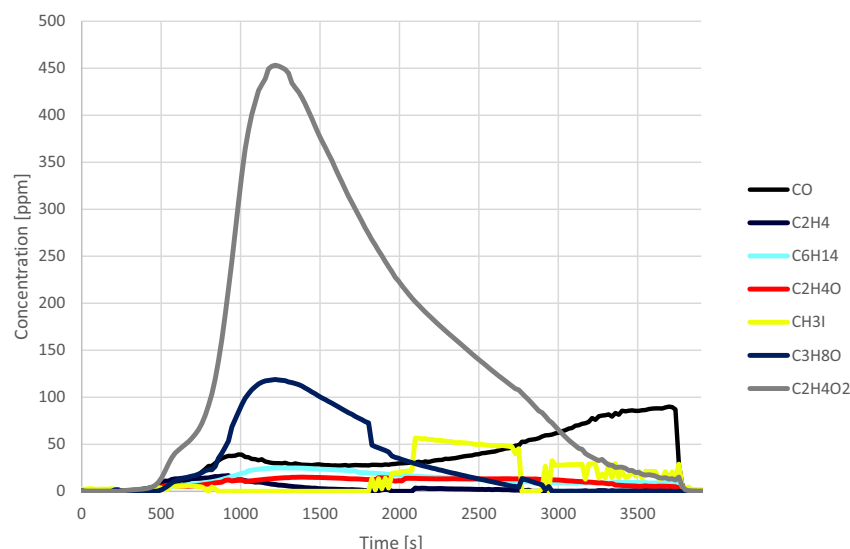


Figure 16. Online concentration analysis of a combustion process of the LSZH cable at 450°C with iodine present. The process is dominated by acetic acid ($C_2H_4O_2$) and isopropanol (C_3H_8O). There is also a clear contribution of CH_3I .

‘considerable’ concentrations for most of the experiment runtime. Presumably, this is due to the layered structure of the cable requiring more time to break down compared to the CSPE cables. The layered structure is also the presumed explanation for the sudden increase in acetaldehyde at 1400 seconds. Presumably some acetaldehyde is retained in the layered structure, until it breaks down to such a degree that the formed acetaldehyde is released, all at once. This also exposes relatively fresh cable material to the gas stream, which is why the acetaldehyde concentration remains at a higher level before it begins to fall off from 1800 seconds and onwards.

Comparing the process with the results at 300°C, there is a vast difference for the LSZH cable. The experiment at 300°C showed barely any releases, whereas the releases of organic species at 450°C are comparable to those of the CSPE cables.

The process at 450°C including iodine is shown in Figure 16.

The addition of iodine to the LSZH-combustion at 450°C gives rise to several new compounds compared to the process without iodine. Acetic acid ($C_2H_4O_2$) has replaced acetaldehyde as the most important combustion product and both isopropanol and methyl iodide can be detected in considerable amounts.

5. Discussion

5.1. Liquid trap concentrations

The different cables give different amounts of iodine in the trap solutions, as seen in Table 3. For the measurements at 200°C and 300°C, all the measured values are similar and without any obvious pattern. No certain conclusions can be drawn from them. However, as was determined in the reference experiments, any presence of organics appears to increase

the amount of iodine caught in the liquid trap, compared to when no organics are present. The reason for this is unclear, but a possibility is that the addition of organic species results in more iodine dissolving because of an increase in ionic strength of the solution. Ionic strength does affect the activity coefficient of all ingoing species of reaction 2 [29]. The CSPE would release HCl and SO_2 , increasing the ionic strength significantly, and the LSZH cable could give a similar effect in that it releases acetic acid. This might also explain why more iodine was retained in the liquid traps for the experiments with CSPE cables compared to the LSZH cables.

At 450°C, there is a clear difference between the CSPE cables and the LSZH cable with the latter giving significantly less iodine in the traps. At 450°C, the liquid trap for the LSZH cable captured a similar amount of iodine as at 300°C (the feeding rate of iodine was the same in all experiments) but the high-temperature experiment lasted twice as long as the low- temperature one. Therefore ‘Moles of iodine captured per minute’ was halved when the temperature was increased. This is assumed to be related to the formation of methyl iodide, which is less soluble in water than triiodide and may therefore escape the trap. These experiments were only conducted in duplicate, meaning no uncertainty analysis is possible.


At 450°C, both CSPE cables gave similar values in the total iodine concentration, about three times the values for the experiment at 300°C. Therefore, even when factoring in the change in experiment duration, more iodine was caught for these cables when the temperature increased.

Looking at Figure 8, for the CSPE cables, the iodine captured in the liquid trap increases to a relatively stable threshold value of ca. 2.7–3.2 mM of iodine after thirty minutes. These first 30 minutes also coincide with the majority of the combustion


releases for these cables (as seen in Figures 13 and 14). It appears that the high presence of organics in these experiments decreases the amount of iodine caught in the liquid trap, compared to the experiments at 300°C.

5.2. Considerations regarding combustion of the CSPE cable

The CSPE cables gave mostly similar species as their major combustion products; mainly HCl, SO₂, CS₂, 1–3-butadiene, acetaldehyde, C₂H₆, plus some longer aliphatic hydrocarbons at the higher temperature. The general combustion reaction for a chlorinated hydrocarbon is seen in Reactions 5 and 6 [30]

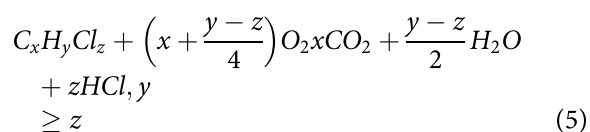

CS₂ is released early and supplanted by SO₂. This behavior is consistent with the overall combustion of CS₂, according to Reaction 7.



This reaction was studied extensively before [31] and proceeds through carbonyl sulfide (COS) which is also measured at a low concentration in our experiments. SO₂ is soluble in water and is acidic, further lowering the pH, though it is less acidic than HCl.

HCl will, of course, reduce the pH of the sump which could affect the iodine chemistry. The sump is kept at a pH of around 9.3 to keep iodine in solution in the form of I⁻. As the pH decreases, iodine may evaporate as I₂. The extent of the effect of HCl on sump pH depends on the amount of sump solution relative to the evolved HCl, which in turn depends on the amount of cable jacket material and the temperature to which it is exposed.

There were in total eight experiments involving CSPE cables in 450°C. The releases from each

experiment can be seen in Table 7. Also included is the total content of chlorine that would be expected in the cable (depending on the weight percentage of chlorine). It is clear that in these conditions, only a small portion of available HCl seems to be released.

There is a clear difference between the fresh and irradiated cables, with the latter releasing significantly less HCl, and at 300°C, the fresh cable produces some C₄H₆, which is not seen for the irradiated cable. There are two reasons for this: the radiation induces crosslinking of the polymers [21], making them more thermally resistant, and the radiation serves to release some material from the cable [21]. This is likely the reason for not forming unsaturated species from the irradiated cable. Potentially these species are formed as sulfur and chlorine are released, whereas this has already happened for the irradiated cables and the unsaturated groups have reacted further. The FTIR measurements of the irradiated cable consistently measured very little CS₂, implying its precursor (the chloro-sulfone groups) may be lost due to irradiation. It bears mentioning that no change in the cable mass could be detected as a result of the irradiation.

The presence of iodine also appears to increase the amount of HCl released. This is seen clearly for the four experiments involving fresh CSPE, where the releases of HCl double upon the addition of iodine. In previous studies [32] when CSPE cables were heated to 400°C in a steam-and nitrogen atmosphere with I₂ present, significant portion of the added iodine was bound to the remnants of the CSPE cable. Considering this, and the result seen here, it appears that iodine might be able to replace the chlorine in the CSPE.

If so, this has potential implications for the sump chemistry in two ways. First, the liberation of HCl will acidify the sump, which is a known phenomenon [24,33]. Second, if iodine binds into the CSPE polymer as it degrades, then it may prevent that iodine from being released. However, the extent of this must be studied further. Also, this effect is reportedly less effective when sodium iodide is used as the iodine source. As most of the iodine is expected to be in the form of CsI in an accident, the effect of this interaction has a limit to how much iodine it can be expected to capture.

Many of the hydrocarbons are non-polar and insoluble in water, meaning they can be expected to collect on the surface of the sump. Potentially, this may serve to make free organic species available for reaction with fission products, such as iodine and/or tellurium. However, the feasibility of such reactions will depend both on the concentration of the ingoing species and on the conditions of the accident (including

Table 7. Releases of HCl at 450°C. Note the difference between the two cables.

Cable type	HCl released [mg]	Amount of cable insulation [g]	Total chlorine content [g]	
			Max [40% Cl]	Min [25% Cl]
Fresh CSPE 1	7	3.6	1.44	0.9
Fresh CSPE 2	8	3.6	1.44	0.9
Fresh CSPE 1 with iodine	15	3.5	1.4	0.88
Fresh CSPE 2 with iodine	14	3.5	1.4	0.88
Irradiated CSPE 1	2	2.4	0.96	0.6
Irradiated CSPE 2	3	2.4	0.96	0.6
Irradiated CSPE 1 with iodine	3	2.4	0.96	0.6
Irradiated CSPE 2 with iodine	3	2.4	0.96	0.6

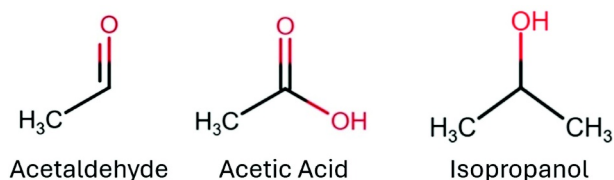


Figure 17. The structure of acetaldehyde, acetic acid and isopropanol.

parameters such as temperature, atmosphere, pH in the sump, radiation field and so on).

In general, the concentration of organic species is lower in the systems including iodine than those without it. This is likely because the added iodine (which is not measurable using FTIR) further dilutes the gas stream, resulting in a lower concentration.

5.3. Considerations regarding combustion of the LSZH cable

The major combustion product for the LSZH cable is acetaldehyde. At lower temperatures, it forms sparingly but at high temperatures it is one of the most-formed organic species. Interactions of acetaldehyde in the sump with dissolved fission products under radiation are unknown but may be worth investigating.

The LSZH cable does not give rise to many combustion products unless the temperature becomes high and, even if it does, it does not give HCl or SO_2 . This means that the pH can be expected to be less affected than in the case of CSPE cables. Aside from the pH, the containment chemistry will be affected due to the release of acetaldehyde or acetic acid. Which of these is formed will likely depend on the rest of the containment chemistry, especially the redox conditions.

5.4. Relationship between acetaldehyde, acetic acid and isopropanol

In the experiments with the LSZH cables at 300°C and 450°C, acetaldehyde, acetic acid and isopropanol interplayed with each other. The structures of acetic acid, acetaldehyde and isopropanol are all shown in Figure 17.

Acetic acid can be formed through the oxidation of acetaldehyde, so the loss of acetaldehyde and

formation of acetic acid in its place is chemically viable in this system, as I_2 is an oxidizing agent. Given the high temperature, the reaction, as depicted in Figure 18, is expected. Some water evolves in the combustion and is confirmed in the FTIR but is not included in the diagrams. HI would also form from this reaction, but as this species cannot be detected from FTIR it is assumed to decompose back to I_2 and water.

The formation of isopropanol can also be explained through the inclusion of iodine. In Figure 16, methyl iodide appears as the concentration of isopropanol decreases, implying that the isopropanol suppresses the formation of methyl iodide by being formed from a reaction that consumes methyl iodide and acetic acid. Therefore, when the formation of acetic acid decreases (presumably because combustible cable material is starting to run out), this reaction no longer occurs, and methyl iodide can be detected.

From the structures presented in Figure 17, the difference between isopropanol and acetic acid is the replacement of one oxygen with one methyl group. Such a replacement reaction is not the expected reaction with methyl iodide on acetic acid. The typical reaction would be the formation of methyl acetate through methylation. Indeed, a small amount of methyl acetate was confirmed in the FTIR, implying this reaction also occurs. However, the main product was isopropanol.

In Figure 16, the concentration of isopropanol closely follows the concentration of acetic acid, and a decrease in acetic acid is necessary for methyl iodide to be detected. A possibility is that the formation of isopropanol occurs through a radical mechanism enabled by the high temperature, but this explanation is tentative and such a reaction mechanism is unorthodox.

The above process also explains the presence of isopropanol, acetic acid and methyl iodide when the CSPE cables are subjected to iodine (see Figure 12). They presumably undergo the same process, but to a much more limited degree, as the CSPE cables form less acetaldehyde than the LSZH cables.

It is unclear exactly how methyl iodide forms in this system, though it likely involves a radical reaction between iodine (I_2) and any of the organic

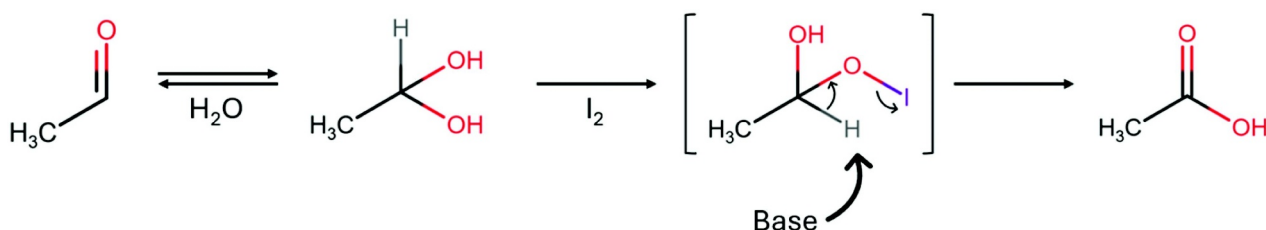


Figure 18. Reaction mechanism for oxidation of acetaldehyde to acetic acid.

radicals formed from the combustion process. Similar reactions are known from the aqueous phase of nuclear accidents [14], and the necessary organic radicals would form as part of the combustion reaction [34].

Isopropanol, if formed according to the above hypothesis, is dependent on the formation of both acetaldehyde and methyl iodide. The latter is especially dependent on the concentrations of the organic precursor and iodine, both of which will likely be low in the case of a nuclear accident. It is therefore not certain that isopropanol will be formed by this reaction, though its presence in, say, paints [35] still make it a species worth considering. If formed, it is miscible in water and will contribute to the sump chemistry.

6. Conclusions

Combustion of the cables used in a NPPs gives rise to multiple volatile species. Depending on the cable type and temperature to which it is exposed, various species evolve, and different consequences may be anticipated.

For chlorosulfonated cables (both irradiated and unirradiated) HCl is a key species. This is important in this context since it can decrease the pH in the containment sump, though the extent depends on how much cable is present and how badly it degrades. The presence of I_2 also appears to affect the releases of HCl quite significantly if the cable is fresh. Other than HCl, the chlorosulfonated cable also evolved aliphatic hydrocarbons, such as C_2H_6 , C_4H_6 and C_6H_{14} , with small amounts of C_2H_4O , as well as the sulfur-containing species CS_2 and SO_2 . The presence of hydrocarbons would affect the sump chemistry and potentially the containment atmosphere chemistry, as they are volatile.

The irradiated cables in general gave less releases than the fresh ones, especially HCl and sulfur-related species. This is in line with existing literature, as both of these species are known to be affected by radiation and removed from the material, resulting in less chlorine and sulfur available for combustion in these cables [21]. Other releases are either similar or lower for the irradiated cables compared to the fresh ones, likely due to crosslinking of the material making it more resistant to the heat.

LSZH cables do not evolve HCl and give practically no releases at 200°C. The release at higher temperature saw acetaldehyde as the most prominent release from the investigated cable. This species can oxidize into acetic acid in the presence of water, an oxidant (such as I_2), and sufficient temperature.

Water will invariably be present if there is an accident, whereas the other factors are less certain but cannot be dismissed.

Experiments confirmed that CH_3I is generated during the combustion of LSZH cables in the presence of gaseous iodine. Although the mechanism for CH_3I generation remains unclear, we also confirmed that the generated CH_3I reacts with acetic acid. It is not thought relevant to the containment at large, though it could potentially occur locally if, say, the corium falls close to the cables. In this study it gave rise to isopropanol, meaning that even though an organic iodide did form, subsequent reactions served to (partially) remove them. Similar reactions were also observed for the CSPE cables, but in a more limited scope.

The question of cable combustion is a complex one, given the large variety of cables available, and accident conditions to consider. Further research is necessary for a continued understanding of this subject. One avenue of interest could be to investigate the leaching behavior of the sump on the cables, especially under irradiation, to determine what organics are then released from the cables. Given the potential acidification of the sump by HCl, changes in pH should also then be considered.

Acknowledgments

The authors acknowledge the Nordic Nuclear Safety Research Organization (NKS), for partially funding this project. The authors would also like to acknowledge Framatome for supplying the LSZH cable that was investigated.

Disclosure statement

No potential conflict of interest was reported by the author(s).

Funding

This work has been supported by the Nordic Nuclear Safety Research (NKS), and APRI12 (Accident Phenomena of Risk Importance).

ORCID

Tuula Kajolinna  <http://orcid.org/0000-0002-8216-1574>
Christian Ekberg  <http://orcid.org/0000-0002-0065-7673>

Data availability statement

Data for this study can be made available upon request.

References

- [1] Kress TS, Beahm EC, Weber CF et al. Fission product transport behavior. *Nucl Technol.* 10101993;101(3):262–269. doi: [10.13182/NT93-A34789](https://doi.org/10.13182/NT93-A34789)
- [2] Shiotsu H, Ito H, Sugiyama T et al. Numerical analysis for FP speciation in VERDON-2 experiment: chemical re-vaporization of iodine in air ingress condition. *Ann Nucl Energy.* 2021;163:108587. doi: [10.1016/j.anucene.2021.108587](https://doi.org/10.1016/j.anucene.2021.108587)
- [3] Grégoire A-C, Haste T. Material release from the bundle in Phébus FP. *Ann Nucl Energy.* 2013;61:63–74. doi: [10.1016/j.anucene.2013.02.037](https://doi.org/10.1016/j.anucene.2013.02.037) retrieved 2021–11–29.
- [4] Simondi-Teisseire B, Girault N, Payot F et al. Iodine behaviour in the containment in Phébus FP tests. *Ann Nucl Energy.* 2013;61:157–169. doi: [10.1016/j.anucene.2013.02.039](https://doi.org/10.1016/j.anucene.2013.02.039) retrieved 2021–11–29.
- [5] Kleykamp H. The chemical state of the fission products in oxide fuels. *J Nucl Mater.* 1985;131(2–3):221–246. doi: [10.1016/0022-3115\(85\)90460-X](https://doi.org/10.1016/0022-3115(85)90460-X) retrieved 2024–01–15.
- [6] Taghipour F, Evans GJ. Radiolytic organic iodide formation under nuclear reactor accident conditions. *Environ Sci Technol.* 2000;34(14):3012–3017. doi: [10.1021/es990507d](https://doi.org/10.1021/es990507d)
- [7] J McFarlane JC. LeBlanc fission product tellurium and cesium telluride chemistry revisited. In: No. AECL-11333. Atomic Energy of Canada Ltd; 1996.
- [8] Wang J, Zhuang S. Removal of cesium ions from aqueous solutions using various separation technologies. *Rev Environ Sci Biotechnol.* 2019;18(2):231–269. doi: [10.1007/s11157-019-09499-9](https://doi.org/10.1007/s11157-019-09499-9)
- [9] SKI report 97:40. Ageing of electrical components in nuclear power plants-relationships between mechanical and chemical degradation after artificial ageing and dielectric behaviour during loca, Kjell Spång, SKI-statens kärnkraftsinspektion. 1997:ISSN 1104–1374.
- [10] Sandrine R, Cantrel L, Yves A et al. Precipitate formation contributing to sump screens clogging of a nuclear power plant during an accident. *Chem Eng Res Des.* 2008;86(6):633–639. doi: [10.1016/j.cherd.2008.03.016](https://doi.org/10.1016/j.cherd.2008.03.016)
- [11] Cubicciotti D, Sehgal BR. Vapor transport of fission products in postulated severe light water reactor accidents. *Nucl Technol.* 1984;65(2):266–291. doi: [10.13182/NT84-A33411](https://doi.org/10.13182/NT84-A33411)
- [12] Kärkelä T, Pasi AE, Espegren F et al. Tellurium retention by containment spray system. *Ann Nucl Energy.* 2021;164:108622. doi: [10.1016/j.anucene.2021.108622](https://doi.org/10.1016/j.anucene.2021.108622)
- [13] Wren JC, Ball JM, Glowa GA. The chemistry of iodine in containment. *Nucl Technol.* 2000;129(3):297–325. doi: [10.13182/NT129-297](https://doi.org/10.13182/NT129-297)
- [14] Bosland L, Colombani J. Review of the potential sources of organic iodides in a NPP containment during a severe accident and remaining uncertainties. *Ann Nucl Energy.* 2020;140:1. doi: [10.1016/j.anucene.2019.107127](https://doi.org/10.1016/j.anucene.2019.107127)
- [15] Kaiho T, editor. Iodine chemistry and applications. Hoboken (NJ), published 2015, ISBN 978–1-118–46629-2, John Wiley & Sons Inc. doi: [10.1002/9781118909911](https://doi.org/10.1002/9781118909911), retrieved 17/10–2024.
- [16] Cantrel L. Radiochemistry of iodine: outcomes of the CAIMAN program. *Nucl Technol.* 2006;156(1):11–28. doi: [10.13182/NT156-11](https://doi.org/10.13182/NT156-11)
- [17] Troy RC, Kelley MD, Nagy JC et al. Non-metal redox kinetics: iodine monobromide reaction with iodide ion and the hydrolysis of IBr. *Inorg Chem.* 1991;30(25):4838–4845. doi: [10.1021/ic00025a030](https://doi.org/10.1021/ic00025a030)
- [18] Toxicity of building materials chapter 3- plastic materials: chlorinated polyethylene (CPE), chlorinated polyvinylchloride (CPVC), chlorosulfonated polyethylene (CSPE) and polychloroprene rubber (CR). In: Pacheco-Torgal F, Jalali S, Fucic A, editors. Chapter Authored by Akovali G, editors. Woodhead Publishing Series in Civil and Structural Engineering. Woodhead Publishing; 2012. p. 54–75, ISBN 9780857091222, doi: [10.1533/9780857096357.54](https://doi.org/10.1533/9780857096357.54) retrieved 2024–11–15.
- [19] Gasa JV, Liu Z, Shaw MT. The relationship between density and elongation-at-break of naturally and artificially aged cable materials used in nuclear power plants. *Polym Degrad Stab.* 2005;87, 1, 1):77–85. doi: [10.1016/j.polyimdegradstab.2004.07.009](https://doi.org/10.1016/j.polyimdegradstab.2004.07.009)
- [20] Anandakumaran K. Aging and condition monitoring studies of composite insulation cables used in nuclear power plants. *IEEE Trans Dielect Electr Insul.* 2007;14(1):227–237. doi: [10.1109/TDEI.2007.302891](https://doi.org/10.1109/TDEI.2007.302891)
- [21] Giurginca M, Zaharescu T. Thermal and radiation behaviour of HNBR and CSPE blends. *Polymer.* 2000;41(20):7583–7587. doi: [10.1016/S0032-3861\(00\)00121-X](https://doi.org/10.1016/S0032-3861(00)00121-X)
- [22] Calmet JF, Carlin F, Nguyen TM et al. Irradiation ageing of CSPE/EPR control command electric cables. Correlation between mechanical properties and oxidation. *Radiat Phys Chem.* 2002;63, 3–6, 3–6):235–239. doi: [10.1016/S0969-806X\(01\)00585-0](https://doi.org/10.1016/S0969-806X(01)00585-0)
- [23] Happ M, Duffy J, Wilson GJ et al. Ullmann's encyclopedia of industrial chemistry - rubber, 8. Synth By Polym Modification. 2011. doi: [10.1002/14356007.o23_o05](https://doi.org/10.1002/14356007.o23_o05)
- [24] Beahm E, Lorenz R, Weber C. NUREG/CR-5950, “Iodine evolution and pH control. Washington DC: U.S. Nuclear Regulatory Commission; 1992.
- [25] R.S. Skipper, flame retardant compositions. U.S. Patent no. 4322575A, 1982. Raychem Limited.
- [26] Vahur S, Teearu A, Peets P et al. ATR-FT-IR spectral collection of conservation materials in the extended region of 4000–80 cm⁻¹. *Anal Bioanal Chem.* 2016;408(13):3373–3379. doi: [10.1007/s00216-016-9411-5](https://doi.org/10.1007/s00216-016-9411-5) retrieved 2025–10–29, specifically the spectrum “ATR-FT-IR spectrum of Polyvinyl acetate 4000–225 cm⁻¹”.
- [27] Auvinen A, Zilliacus R, Jokiniemi J. Chlorine release from Hypalon cable insulation during severe nuclear reactor accidents. *Nucl Technol.* 2005;149(2):232–241. doi: [10.13182/NT05-A3592](https://doi.org/10.13182/NT05-A3592)
- [28] Hodgkin JH, Galbraith MN, Chong YK. Combustion products from burning polyethylene. *J Macromol Sci: Part A Chem.* 1982;17(1):35–44. doi: [10.1080/0022338208056463](https://doi.org/10.1080/0022338208056463)
- [29] Palmer DA, Ramette RW, Mesmer RE. Triiodide ion formation equilibrium and activity coefficients in aqueous solution. *J Solution Chem.* 1984;13(9):673–683. doi: [10.1007/BF00650374](https://doi.org/10.1007/BF00650374)

- [30] Senkan SM. Combustion of chlorinated hydrocarbons. In: Vovelle C, editor. Pollutants from combustion. NATO science series. Vol. 547. Dordrecht: Springer; 2000. doi: [10.1007/978-94-011-4249-6_15](https://doi.org/10.1007/978-94-011-4249-6_15) retrieved 2025-10-29.
- [31] Zeng Z, Dlugogorski BZ, Oluwoye I et al. Combustion chemistry of carbon disulphide (CS₂). Combust & Flame. 2019;210:413–425. doi: [10.1016/j.combustflame.2019.09.005](https://doi.org/10.1016/j.combustflame.2019.09.005)
- [32] Fridemo L, Liljenzin J-O. Produkter från kabelpyrolys, Statens kärnkraftsinspektion (SKI), ref. G.2.1/1284/82. 1988:B83/84.
- [33] Liljenzin J-O, Lindqvist O. Influence of minor materials of iodine behavior, In: “Proceedings of the international centre for heat and mass transfer”. Dubrovnik, Yugoslavia; 1990.
- [34] Laoutid F, Bonnaud L, Alexandre M et al. New prospects in flame retardant polymer materials: from fundamentals to nanocomposites. Mater Sci Eng R: Rep. 2009;63(3):100–125. doi: [10.1016/j.mser.2008.09.002](https://doi.org/10.1016/j.mser.2008.09.002)
- [35] MSDS (Material Safety Data Sheet). Teknos, Teknopox aqua V A hardener comp. B; 2006.